

# **Migrating PanelView Standard Applications to PanelView Plus 7**











# **Important User Information**

Read this document and the documents listed in the additional resources section about installation, configuration, and operation of this equipment before you install, configure, operate, or maintain this product. Users are required to familiarize themselves with installation and wiring instructions in addition to requirements of all applicable codes, laws, and standards.

Activities including installation, adjustments, putting into service, use, assembly, disassembly, and maintenance are required to be carried out by suitably trained personnel in accordance with applicable code of practice.

If this equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

In no event will Rockwell Automation, Inc. be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment.

The examples and diagrams in this manual are included solely for illustrative purposes. Because of the many variables and requirements associated with any particular installation, Rockwell Automation, Inc. cannot assume responsibility or liability for actual use based on the examples and diagrams.

No patent liability is assumed by Rockwell Automation, Inc. with respect to use of information, circuits, equipment, or software described in this manual.

Reproduction of the contents of this manual, in whole or in part, without written permission of Rockwell Automation, Inc., is prohibited.

Throughout this manual, when necessary, we use notes to make you aware of safety considerations.



**WARNING:** Identifies information about practices or circumstances that can cause an explosion in a hazardous environment, which may lead to personal injury or death, property damage, or economic loss.



**ATTENTION:** Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss. Attentions help you identify a hazard, avoid a hazard, and recognize the consequence.

**IMPORTANT** 

Identifies information that is critical for successful application and understanding of the product.

Labels may also be on or inside the equipment to provide specific precautions.



**SHOCK HAZARD:** Labels may be on or inside the equipment, for example, a drive or motor, to alert people that dangerous voltage may be present.




**BURN HAZARD:** Labels may be on or inside the equipment, for example, a drive or motor, to alert people that surfaces may reach dangerous temperatures.




**ARC FLASH HAZARD:** Labels may be on or inside the equipment, for example, a motor control center, to alert people to potential Arc Flash. Arc Flash will cause severe injury or death. Wear proper Personal Protective Equipment (PPE). Follow ALL Regulatory requirements for safe work practices and for Personal Protective Equipment (PPE).


# We Can Get You from Here ...

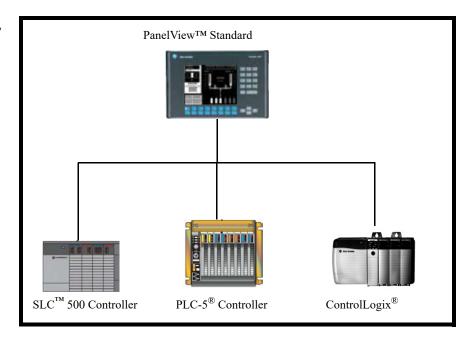

### ... to Here

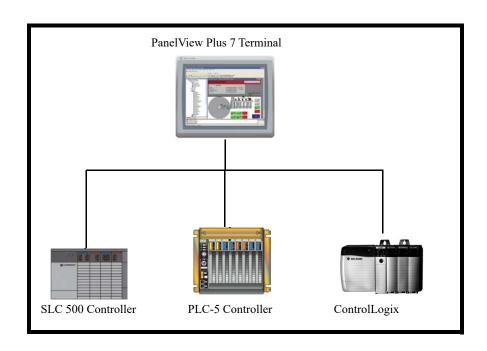

Follow this path to migrate your PanelView Standard terminal and application to the PanelView Plus 7 terminal platform.

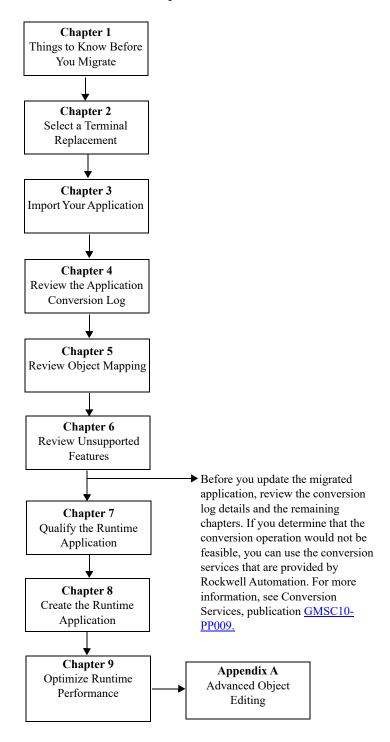

	Pretace	
	Introduction	9
	Summary of Changes	
	Audience	
	Required Software	
	Additional Resources	10
	Chapter 1	
Things to Know before You	Introduction	11
Migrate	External Fonts	11
<b>3</b>	Retain Last States on Startup	
	Unsupported Characters in Tag Names and Addresses	12
	Bit Array Tags	12
	String Tags	12
	Alarm Trigger Tags	
	Bit Position Triggers	
	Least Significant Bit Triggers	
	Alarm Messages	
	Tags Assigned to Message Connections	
	Chapter 2	
Select a Terminal Replacement	Introduction	17
•	Before You Begin	17
	Follow These Steps	
	Selecting a Terminal Replacement	
	Catalog Number Conversion Tables	
	PanelView Standard 300 and 300 Micro Terminals	
	Conversions.	19
	PanelView Standard 550 Terminals Conversions	
	PanelView Standard 600 Terminals Conversions	
	PanelView Standard 900 Terminals Conversions	
	PanelView Standard 1000 Terminals Conversions	
	PanelView Standard 1400 Terminals Conversions	
	PanelView Enhanced 1000e, 1200e, 1400e Terminals	10
	Conversions	42
	Accessories	
	Legacy Communication Support	
	Adapter Kit Conversion Table	
	Function Key Comparisons	
	Installing a PanelView Plus 7 Terminal	
	Chapter 3	
mport Your Application	Introduction	47
	Before You Begin	
	What You Need.	

	Follow These Steps	. 48
	Import Application	. 48
	Post Conversion Tips	. 52
	Chapter 4	
Review the Application	Introduction	. 53
Conversion Log	Before You Begin	. 53
<b>-</b>	What You Need	. 53
	Follow These Steps	. 53
	About the Conversion Log	. 54
	Open the Conversion Log	. 54
	Review the Conversion Log	. 55
	Conversion Messages You Can Ignore	
	RSLinx Messages	
	Screen and Object Conversion Messages	. 57
	Tag Conversion Messages	
	Alarm Conversion Messages	
	Chapter 5	
Review Object Mapping	Introduction	. 61
, ,	Before You Begin	. 61
	What You Need	
	Follow These Steps	
	Reviewing Object Mapping	
	Reviewing Data Type Mapping	
	Reviewing Mapping of Communication Networks	
	Chapter 6	
Review Unsupported Features	Introduction	. 65
••	Before You Begin	. 65
	What You Need.	
	Follow These Steps	. 65
	Reviewing Unsupported Objects	
	Reviewing Unsupported Tags and Controls	
	Reviewing Unsupported Features	
	Chapter 7	
Qualify the Runtime Application	Introduction	. 69
<b></b>	Before You Begin	
	What You Need.	
	Follow These Steps	
	Review Diagnostic Lists	
	Configure the Runtime Diagnostic Display	
	Review Error States for Graphic Objects	
	Title Ziror others for Simplific Objects	. , 5

	Configure Communication	74
	ControlNet Communication	76
	Test Run Graphic Displays	76
	Test Run the Application	79
	Chapter 8	
Create the Runtime Application	Introduction	81
	Before You Begin	
	What You Need.	
	Follow These Steps	
	Create the Runtime Application	
	Download the Runtime Application	
	Download Application Using Ethernet Connection	
	Download Application Using External Storage	
	Run the Application	
	Chapter 9	
<b>Optimize Runtime Performance</b>	Introduction	93
•	Before You Begin	
	What You Need.	
	Follow These Steps	
	Benchmarking Performance	
	Reviewing Tag Update Rate	
	Measure Performance of Display Changes	
	Reviewing Background Updates	
	Global Connections	
	Alarms	98
	Information Messages	98
	Optimize Tags for Network Performance	98
	About the Tag Converter Wizard	99
	Export the HMI Tag Database	100
	Export Graphic Displays to XML File	103
	Export Alarms to XML File	
	Run the Tag Converter Wizard	109
	Reimport the Display XML File	
	Reimport the Alarms XML File	116
	Appendix A	
Advanced Object Editing	Introduction	119
-	Property Panel	
	Edit Multiple Objects	
	Object Explorer	
	Substitute Tags	

Ta	h	l۵	۸f	Col	ntei	ntc

Notes:

#### Introduction

This document provides guidelines and procedures for migrating a PanelView<sup>™</sup> Standard terminal application to the PanelView Plus 7 terminal platform. The procedures and guidelines cover the following:

- Selecting and optionally installing a PanelView Plus 7 terminal replacement
- Importing your PanelView Standard application into the FactoryTalk® View Machine Edition software
- Updating the imported application and ladder logic, as necessary, for compatibility with FactoryTalk View Machine Edition software
- Reviewing unsupported features
- Verifying the correct operation of the imported application on the PanelView Plus 7 terminal
- Measuring and improving performance of the migrated application

The procedures and guidelines are designed to make the migration process as easy as possible.

The beginning of most chapters contains the following information. Read these sections carefully before beginning work in each chapter.

- Before You Begin This section lists the steps that must be completed
  and decisions that must be made before starting the chapter. The
  chapters in this quick start must be completed or reviewed in the order
  in which they appear.
- What You Need This section lists the items that are required to complete the steps in the current chapter. These items include, but are not limited to, hardware and software.
- Follow These Steps This section illustrates the path or steps in the current chapter.

Also note that the electronic version of this publication contains links to other publications for easier navigation and reference.

# **Summary of Changes**

This publication contains new and updated information as indicated in the following table.

Торіс	Pages
Added information about the availability of conformal coating for the 15 in. combination keypad and touch terminal (2711P-B15C22D9PK).	3739

#### **Audience**

This quick start was created to assist a user familiar with Rockwell Automation® HMI products on how to convert existing PanelView Standard applications to FactoryTalk View Machine Edition applications that run on PanelView Plus 7 terminals.

# **Required Software**

The table lists the software that is required to convert a PanelView Standard application to a PanelView Plus 7 application.

Software	Terminal Type	Software Version	
FactoryTalk View Studio, which includes:	PanelView Plus 7 Standard	4.0 or later	
FactoryTalk View Machine Edition RSLinx® Enterprise	PanelView Plus 7 Performance	5.1 or earlier	
	PanelView Plus 7 Performance	6.0 or later	
PanelBuilder®32	_	3.83 or earlier	

# **Additional Resources**

These documents contain additional information about related products from Rockwell Automation.

Resource	Description
Adapter Kit for PanelView 5500 and PanelView Plus 7 Performance Terminals Installation Instructions, publication VIEW-IN002	Provides information on how to install a PanelView Plus 7 terminal into an existing cutout from a PanelView Standard terminal.
Legacy PanelView Terminals to PanelView Plus 7 Terminals Catalog Number Conversions Migration Guide, publication 2711P-AP005	Provides information on how to convert legacy 2711 PanelView Standard terminals and 2711E PanelView Enhanced terminals to the new generation terminals: PanelView Plus 7 Standard terminals and PanelView Plus 7 Performance terminals.
PanelView Plus 7 Performance Terminals User Manual, publication 2711P-UM008	Provides information on how to install, operate, configure, and troubleshoot PanelView Plus 7 performance terminals.
PanelView Plus 7 Standard Terminals User Manual, publication 2711P-UM007	Provides information on how to install, operate, configure, and troubleshoot PanelView Plus 7 standard terminals.
Visualization Solutions Selection Guide, publication VIEW-SG001	Provides an overview of visualization products, including PanelView Plus 7 terminals.
FactoryTalk View Studio online help	Provides information and procedures on how to create FactoryTalk View Machine Edition applications and supported features.
Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1	Provides general guidelines on how to install a Rockwell Automation industrial system.
Product Certifications website, <u>rok.auto/certifications</u>	Provides declarations of conformity, certificates, and other certification details.

You can view or download publications at rok.auto/literature.

# **Things to Know Before You Migrate**

### Introduction

This chapter covers important considerations and helpful things to know before migrating a PanelView™ Standard application to a PanelView Plus 7 platform.

The table covers important considerations when migrating an application.

**Table 1 - Migration Considerations** 

Migration Consideration	Explanation	For More Information
Application reuse?	Do you need to reuse your PanelView Standard application and PLC ladder logic? If so, you can convert your application for use with a PanelView Plus terminal using FactoryTalk® View Machine Edition (ME) software. The application and PLC ladder logic may require updates because some objects or features may not directly migrate to FactoryTalk View ME software.  If you want to create a FactoryTalk View ME application instead of reusing your current application, stop here.	Refer to <u>Reviewing Object Mapping on page 62</u> Refer to <u>Reviewing Unsupported Features on page 66</u>
Require enhanced features?	<ul> <li>Does your application require enhanced features? If so, you can take advantage of the advanced features that are offered by the PanelView Plus 7 terminals:         <ul> <li>Functions: trending, data logging, alarming, information and local messages, expressions, security, language switching, recipes, global objects, multiversion support, faceplates, graphic libraries, parameter files, rich graphics, and animation.</li> <li>Communication: Ethernet and third-party connectivity to additional protocols. Ethernet is the preferred communication.</li> <li>Hardware: 8-wire analog resistive touch screen, x86                 1 GHz processor, 512 MB RAM and 512 MB nonvolatile memory, USB and Secure Digital (SD) media support, modular display, communication, and logic components.</li> <li>Remote connectivity: FTP server, web server, VNC client/server, ActiveX controls, PDF reader, and FactoryTalk ViewPoint remote access is available on all PanelView Plus 7 Standard and Performance terminals.</li> <li>Extended features: PanelView Plus 7 Performance terminals include a web browser, remote desktop connection, Microsoft Office file viewers, and WordPad text editor.</li> </ul> </li> </ul>	
Terminal replacement options?	The terminal replacement for the PanelView Standard platform is the PanelView Plus 7 platform.	Refer to <u>Selecting a Terminal Replacement</u> on page 18

### **External Fonts**

Before importing a PanelBuilder®32 application that uses external fonts, make sure that the external font file is in this directory:

C:\Program Files\Allen-Bradley\PBEX\Fonts

If the conversion utility does not find the external font in this location, the conversion stops without reporting an error.

# **Retain Last States on Startup**

PanelBuilder32 software lets you choose to retain the last states on startup for all objects. FactoryTalk View Machine Edition (ME) software does not have this feature.

# Unsupported Characters in Tag Names and Addresses

PanelBuilder32 software supports semicolons (;) in tag addresses; FactoryTalk View ME software does not. Before importing your application into FactoryTalk View ME software, change the semicolons (;) to colons (:) in the PanelBuilder32 tag editor.

PanelBuilder32 software supports dashes (-) in tag names, FactoryTalk View ME software does not. Before importing your application to FactoryTalk View ME software, search the PanelBuilder32 tag editor for tag names with dashes and duplicate the tags. Rename the tags to eliminate the dash, or replace the dash with an underscore (\_). Use the tag search function to find graphic objects using the original tag names. Edit the objects to update the tag names.

# **Bit Array Tags**

You can monitor bit arrays for alarm conditions in FactoryTalk View applications but you can't assign bit arrays to graphic objects, or write to bit arrays. This condition means all bit array tags in your PanelBuilder32 application are converted to memory tags in the FactoryTalk View ME application.

# **String Tags**

At runtime, FactoryTalk View ME applications support a maximum length of 82 characters. Because PanelBuilder32 protocols support longer strings, some alarm messages may be truncated after conversion.

# **Alarm Trigger Tags**

Bit arrays with the Bit or LSBit trigger types are used to trigger alarm messages in a FactoryTalk View ME application. Assigning alarm triggers to elements in a bit array, instead of bit addresses, frees up tags in the database for other uses. When an element of an array changes from 0 to 1, it can generate an alarm message if a message has been created for that bit position. With the Bit trigger type, you can generate simultaneous alarm messages, one for each element. With the LSB trigger type, only the lowest bit position triggers an alarm:

- In a PanelBuilder32 application, the trigger value for the bit data type ranges from 0...31.
- In a FactoryTalk View ME application, the trigger value for the bit data type ranges from 1...32.

The number of bits in the array depends on the data type of the tag. Integer data types, for example, return 16 bits per element, while Bit data types return 8 bits per element.

To trigger a digital alarm that is based on an array of controller bits, you must use a direct reference and the syntax:

tagname, Larraylength (for example, [PLC5]N7:0,L5)

TIP Don't leave a space between the tag address and the length. For example, the address {[SLC]BlockWrite1, L8}, where BlockWrite is the equivalent of N7:0, does not work. {[SLC]BlockWrite1,L8} works.

#### **Bit Position Triggers**

Follow these steps in the FactoryTalk View ME application to trigger alarms by using bit positions.

- 1. In the Trigger tab of the Alarm Setup editor, create a Bit type alarm trigger.
- 2. In the Trigger dialog box, click Browse in the Tag column and browse to the first element of an array.
  - For example, in a Logix5000<sup>™</sup> controller that is called CLGX1, select AAlm[0], which is an integer tag type.
- 3. Click OK to insert the tag address into your trigger tag.
  - This address {[CLGX1]AAlm[0]} is the starting element in your array tag. [CLGX1] is the direct reference or the RSLinx\* Enterprise device shortcut name.
- 4. Double-click the address and append a comma and the letter L to the address, then type the number of elements you want to include in your array tag.
  - To add 64 elements to the example address, modify it to read  $\{[CLGX1]AAlm[0],L64]\}$ . This syntax returns  $(64 \times 16 =) 1024$  bits. Do not leave a space between the tag address and the length.
- 5. In the Messages tab, assign trigger values and alarm messages to as many of the elements in the array tag as you like.
  - Each trigger value corresponds to a bit position, not a bit address.

In the Trigger Value column, enter a number for the element that triggers the message, then create the message in the Message column. When that element in the array changes value, it triggers the alarm and display the message.

Bit Position	Trigger Value	Message
1	1	Line 1: Conveyor has stopped
2	2	Line 1: Power failure
3	3	Line 2: Conveyor has stopped
4	4	Line 2: Power failure
1024	1024	Line 6: Oven door open

#### **Least Significant Bit Triggers**

Follow these steps to trigger alarms using Least Significant Bit positions.

- 1. In the Trigger tab of the Alarm Setup editor, create an LSBit type alarm trigger.
- 2. In the Trigger dialog box, click Browse in the Tag column and browse to the first element of an array.
  - For example, in a PLC-5° controller, select an integer tag N7:61. For this example, only the first three-bit positions are used, so there's no need to specify a length (L) for the array. To also monitor bits in N7:62, add L2 to the address: [PLC5]N7:61,L2.
- 3. Specify these trigger values and alarm messages for the alarm trigger.

Bit in Array	rray Bit Position Trigger Value		Message
00	1	1	Motor has lost power
01	2	2	Motor has stopped
02	3	3	Overload switch has lost power

If the motor loses power at runtime, all three-bit values change from 0 to 1. Only the first alarm message is generated, because bit 00 is the least significant or the lowest bit. If the operator acknowledges the first alarm and power is not yet restored, the second alarm is generated, and so on.

# **Alarm Messages**

Both PanelBuilder 32 and Machine Edition applications perform the same three steps when an alarm is triggered.

- 1. Send the alarm message to the Data Tag connection.
- 2. Set the Notification Tag connection to 1.
- 3. Reset the Notification Tag connection to 0 when the Handshake tag changes to a nonzero value.

The PanelBuilder32 application performs additional steps that are not required by the ME application.

- 4. Send Null (00) to the Data Tag, overwriting the alarm message.
- 5. Set the Notification Tag to 1.
- 6. Reset the Notification Tag to 0 when the Handshake tag changes to a new nonzero value.

The Data tag is now ready to accept a new alarm message.

# Tags Assigned to Message Connections

Some PanelBuilder32 tags are assigned to Message connections in the converted Machine Edition application.

This Tag in PanelBuilder32	Is Assigned to This Connection in ME
Remote Device Data tag	Message connection
Remote Device Notification tag	Message Notification connection
Remote Device Handshake tag	Message Handshake connection

Notes:

# **Select a Terminal Replacement**

# Introduction


In this chapter, you select and optionally install a PanelView™ Plus 7 terminal replacement for your PanelView Standard terminal.

# **Before You Begin**

Review the migration considerations table (chapter 1).

# **Follow These Steps**

Follow these steps to select a PanelView Plus 7 terminal as a replacement for your PanelView Standard terminal.



# Selecting a Terminal Replacement

Replacement options for the PanelView Standard terminals include the following platforms:

- PanelView Plus 7 Performance terminals
- PanelView Plus 7 Standard terminals

Some of the PanelView Plus 7 terminals fit directly into the existing panel cutouts of the PanelView Standard terminals; others require an adapter kit.

None of the PanelView Plus 7 terminals fit into the panel cutouts of the PanelView Standard 300 or 300 Micro terminals.

- TIP- References to PanelView Plus 700, 1000, 1250, or 1500 terminals apply to both the PanelView Plus 6 (700...1500) and PanelView Plus 700 to 1500 platforms.
  - PanelView Plus Compact terminals use the same cutouts and adapter kits as the corresponding PanelView Plus 400, 600, and 1000 models.

### **Catalog Number Conversion Tables**

Tables in this section provide a direct catalog number conversion for your PanelView Standard terminal to a compatible PanelView Plus 7 terminal.

#### **PanelView Standard 300 and 300 Micro Terminals Conversions**

See the tables in this section for primary and secondary conversions for PanelView Standard 300 and 300 Micro terminals.

#### PanelView Standard 300 and 300 Micro Terminals Primary Replacement Options

PanelView Standard Terminals					PanelView Plus 7 Terminals – Primary Replacement Options									
		Panel C Dimens					Panel Cutout Dimensions							
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm(in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes		
	2711-K3A5L1K					RS-232 (DF1)							PanelView Plus 7 Standard 4-in.	
300	2711-K3A10L1		76) (5.53)					DH-485						
	2711-K3A17L1	197 (7.76)		)	RS-232 (D-485)					One		Application limits:  • Max. screen count: 100  • Max. alarm messages: 500		
	2711-K3A2L1			1:	128 x 64	RS-232 (D-485)	2711P-T4W21D8S	92 (3.62)		480 x 272	Ethernet port	N/A	Max. number of controllers: 1 Communication = Ethernet (dual Ethernet ports are)	
300	2711-K3A5L1				DeviceNet and RS-232							available). Operator input = only touch.		
	2711-M3A18L1	133	111		RS-232							Power input = only DC. Conformal coat = No.		
Micro	2711-M3A19L1	(5.23)	(4.38)		(DF1)									

#### PanelView Standard 300 and 300 Micro Terminals Secondary Replacement Options

-	Panel	View Sta	ndard Ter	minals			PanelV	iew Plus	7 Terminals – S	econdary F	eplacemen	t Options
		Panel C Dimens					Panel C Dimens					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K3A5L1K				RS-232 (DF1)							
	2711-K3A10L1				DH-485							PanelView Plus 7 Performance
300	2711-K3A17L1	197 (7.76)	140 (5.53)		RS-232 (D-485)					Dual		6.5 in. terminal benefits:  Higher resolution  DLR
	2711-K3A2L1			128 x 64	RS-232 (D-485)	2711P-B7C22D9P	142 (5.59)	237 (9.33)	640 x 480	Ethernet ports	N/A	Communication = Ethernet. Operator input = keypad and touch.
	2711-K3A5L1				DeviceNet and RS-232							Power input = only DC. Conformal coat = No.
300 Micro	2711-M3A18L1	133	111		RS-232							
	2711-M3A19L1	(5.23)	(4.38)		(DF1)							

#### **PanelView Standard 550 Terminals Conversions**

See the tables in this section for primary and secondary conversions for PanelView Standard 550 terminals.

#### **PanelView Standard 550 Terminals Primary Replacement Options**

	Pane	IView Sta	ndard Terr	minals			Panel	View Plu	s 7 Terminals –	Primary Re	placement	Options
		Panel Co Dimens	utout ions				Panel C Dimens	utout ions				
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K5A1				Remote I/O							
	2711-K5A1L1				nemote i/O							
	2711-K5A10											
	2711-K5A10L1				DeviceNet							
	2711-K5A14				Devicemen							
	2711-K5A14L1											
	2711-K5A12				RS-232							
	2711-K5A12L1				N3-232							
	2711-K5A16				RS-232							
	2711-K5A16L1				(DF1)							
	2711-K5A15				ControlNet							
	2711-K5A15L1				Controlnet							
	2711-K5A2											
	2711-K5A2L1				DH-485							PanelView Plus 7 Standard 6 in.
	2711-K5A3				υπ- <del>4</del> 03							terminal benefits: Higher resolution
	2711-K5A3L1											Application limits:  • Max. screen count: 100
550	2711-K5A5	167	266	256 x 128		2711P-T6C21D8S	123	156	640 x 480	One Ethernet	N/A	Max. alarm messages: 500     Max. number of controllers: 1
330	2711-K5A5L1	(6.57)	(10.47)	230 X 120	RS-232	2/117-10(21003	(4.84)	(6.14)	040 X 460	port	IN/A	Communication = Ethernet
	2711-K5A9				(DH-485)							(dual Ethernet ports are available).
	2711-K5A9L1											Operator input = only touch.  Power input = only DC.
	2711-K5A8				DH+™							Conformal coat = No.
	2711-K5A8L1				νπ÷····							
	2711-K5A20				Feb au Nat /ID							
	2711-K5A20L1				EtherNet/IP							
	2711-B5A1				Remote I/O							
	2711-B5A1L1				Kelliote I/O							
	2711-B5A10											
	2711-B5A10L1				DavisaNat							
	2711-B5A14				DeviceNet							
	2711-B5A14L1											
	2711-B5A12				DC 222							
	2711-B5A12L1				RS-232							
	2711-B5A16				RS-232							
	2711-B5A16L1				(DF1)							

#### PanelView Standard 550 Terminals Primary Replacement Options (continued)

	Pane	lView Sta	ndard Teri	minals			Panel	lView Plu	ıs 7 Terminals –	· Primary R	eplacement	Options
		Panel Co Dimens					Panel C Dimens					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-B5A15				ControlNet							
	2711-B5A15L1				Controller							
	2711-B5A2											
	2711-B5A2L1				DH-485							
	2711-B5A3				711 403							
	2711-B5A3L1											
	2711-B5A5	167	266	256 x 128								
	2711-B5A5L1	(6.57)	(10.47)	230 x 120	RS-232							
	2711-B5A9				(DH-485)							
	2711-B5A9L1											PanelView Plus 7 Standard 6 in.
	2711-B5A8				DH+							terminal benefits: Higher resolution
	2711-B5A8L1				νπ÷							Application limits:
	2711-B5A20				EtherNet/IP		122	156		One		Max. screen count: 100     Max. alarm messages: 500
550	2711-B5A20L1				Eulernet/IP	2711P-T6C21D8S	123 (4.84)	(6.14)	640 x 480	Ethernet port	N/A	Max. number of controllers: 1 Communication = Ethernet
	2711-T5A1L1				Remote I/O							(dual Ethernet ports are available).
	2711-T5A10L1				DeviceNet							Operator input = only touch.
	2711-T5A14L1				Devicenet							Power input = only DC. Conformal coat = No.
	2711-T5A12L1				RS-232							
	2711-T5A16L1	-			RS-232 (DF1)							
	2711-T5A15L1	152	185	256 x 128	ControlNet							
	2711-T5A2L1	(6.0)	(7.28)		DII 405							
	2711-T5A3L1				DH-485							
	2711-T5A5L1	1			RS-232							
	2711-T5A9L1	1			(DH-485)							
	2711-T5A8L1	1			DH+	1						
	2711-T5A20L1	1			EtherNet/IP	1						

#### **PanelView Standard 550 Terminals Secondary Replacement Options**

	Panel	View Sta	ndard Ter	minals			PanelVi	ew Plus 7	Terminals – Se	condary Re	placement (	Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K5A1				Remote I/O	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A1L1				nemote 1/0	2711P-B7C22D9P						
	2711-K5A10					2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A10L1				DeviceNet	2711P-B7C22D9P						
	2711-K5A14				Devicence	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A14L1					2711P-B7C22D9P						
	2711-K5A12				RS-232	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A12L1					2711P-B7C22D9P						
	2711-K5A16				RS-232	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A16L1				(DF1)	2711P-B7C22D9P						
	2711-K5A15				ControlNet	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A15L1					2711P-B7C22D9P						
	2711-K5A2					2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A2L1				DH-485	2711P-B7C22D9P						
	2711-K5A3					2711P-B7C22A9P <sup>(1)</sup>						PanelView Plus 7 Performance
	2711-K5A3L1					2711P-B7C22D9P						<ul><li>6.5 in. terminal benefits:</li><li>Higher resolution</li></ul>
550	2711-K5A5	167	266	256 x 128		2711P-B7C22A9P <sup>(1)</sup>	142	237	640 x 480	Dual Ethernet	N/A	• DLR Communication = Ethernet.
	2711-K5A5L1	(6.57)	(10.47)		RS-232	2711P-B7C22D9P	(5.59)	(9.33)		ports		Operator input = keypad and touch.
	2711-K5A9				(DH-485)	2711P-B7C22A9P <sup>(1)</sup>						Power input = AC or DC. <sup>(1)</sup> Conformal coat = No.
	2711-K5A9L1					2711P-B7C22D9P						Conformal coat = No.
	2711-K5A8				DH+	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A8L1					2711P-B7C22D9P						
	2711-K5A20				EtherNet/IP	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K5A20L1					2711P-B7C22D9P						
	2711-B5A1				Remote I/O	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A1L1					2711P-B7C22D9P						
	2711-B5A10					2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A10L1				DeviceNet	2711P-B7C22D9P						
	2711-B5A14					2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A14L1					2711P-B7C22D9P						
	2711-B5A12				RS-232	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A12L1					2711P-B7C22D9P						
	2711-B5A16				RS-232 (DF1)	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A16L1				(011)	2711P-B7C22D9P						

#### PanelView Standard 550 Terminals Secondary Replacement Options (continued)

	Panel	View Sta	ndard Ter	minals			PanelVie	ew Plus 7	Terminals – Se	condary Re	placement (	Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-B5A15				ControlNet	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A15L1				controllect	2711P-B7C22D9P						
	2711-B5A2					2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A2L1				DH-485	2711P-B7C22D9P						
	2711-B5A3				DI1 403	2711P-B7C22A9P <sup>(1)</sup>						PanelView Plus 7 Performance
	2711-B5A3L1					2711P-B7C22D9P						<ul><li>6.5 in. terminal benefits:</li><li>Higher resolution</li></ul>
	2711-B5A5	167	266	256 x 128		2711P-B7C22A9P <sup>(1)</sup>	142	237	640 x 480			• DLR Communication = Ethernet.
	2711-B5A5L1	(6.57)	(10.47)	230 X 120	RS-232	2711P-B7C22D9P	(5.59)	(9.33)	040 X 400			Operator input = keypad and
	2711-B5A9				(DH-485)	2711P-B7C22A9P <sup>(1)</sup>						touch. Power input = AC or DC. (1)
	2711-B5A9L1					2711P-B7C22D9P						Conformal coat = No.
	2711-B5A8				DH+	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B5A8L1				DIII	2711P-B7C22D9P						
	2711-B5A20				EtherNet/IP	2711P-B7C22A9P <sup>(1)</sup>				Dual		
550	2711-B5A20L1				Luicincu	2711P-B7C22D9P				Ethernet ports	N/A	
	2711-T5A1L1				Remote I/O							
	2711-T5A10L1				DeviceNet							
	2711-T5A14L1				Devicence							
	2711-T5A12L1				RS-232							
	2711-T5A16L1				RS-232 (DF1)							PanelView Plus 7 Performance 6.5 in. terminal benefits: • Higher resolution
	2711-T5A15L1	152	185	256 x 128	ControlNet	2711P-T7C22D9P	142	184	640 x 480			DLR Communication = Ethernet.
	2711-T5A2L1	(6.0)	(7.28)		DII 405		(5.59)	(7.24)				Operator input = only touch.
	2711-T5A3L1				DH-485							Power input = DC. Conformal coat = Yes <sup>(2)</sup>
	2711-T5A5L1				RS-232							
	2711-T5A9L1				(DH-485)							
	2711-T5A8L1				DH+							
	2711-T5A20L1				EtherNet/IP							

<sup>(1)</sup> AC power is only available on Series A terminals. DC power is only available on Series B terminals.

<sup>(2)</sup> Conformal coating is available for all DC-power, touch terminals. To order a terminal that is conformal-coated, add K to the end of a DC-power, touch catalog number; for example, 2711P-T7C22D9PK.

#### **PanelView Standard 600 Terminals Conversions**

See the tables in this section for primary and secondary conversions for PanelView Standard 600 terminals.

#### **PanelView Standard 600 Terminals Primary Replacement Options**

	Pane	View Sta	ndard Ter	minals			Panel\	liew Plus	7 Terminals – P	rimary Rep	lacement 0	ptions
		Panel C Dimens					Panel Co Dimens	utout ions				
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K6C1				Remote I/O	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C1L1				Kelliote I/O	2711P-B7C22D9P						
	2711-K6C10					2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C10L1				DeviceNet	2711P-B7C22D9P	Ī					
	2711-K6C14				Devicemen	2711P-B7C22A9P <sup>(1)</sup>	Ī					
	2711-K6C14L1					2711P-B7C22D9P	Ī					
	2711-K6C12				RS-232	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C12L1				113-232	2711P-B7C22D9P	Ī					
	2711-K6C16				RS-232	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C16L1				(DF1)	2711P-B7C22D9P						
	2711-K6C15				ControlNet	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C15L1				Controllect	2711P-B7C22D9P	Ī					
	2711-K6C2					2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C2L1				DH-485	2711P-B7C22D9P						2 111 21 -2 6
	2711-K6C3				1011-403	2711P-B7C22A9P <sup>(1)</sup>						PanelView Plus 7 Performance 6.5 in. terminals benefits:
	2711-K6C3L1					2711P-B7C22D9P						Higher resolution     DLR
600	2711-K6C5	192	290	320 x 234		2711P-B7C22A9P <sup>(1)</sup>	142	237	640 x 480	Dual Ethernet	2711P-	Communication = Ethernet. Operator input = keypad and
000	2711-K6C5L1	(7.55)	(11.40)	320 X 234	RS-232	2711P-B7C22D9P	(5.59)	(9.33)	040 % 400	ports	RAAK7	touch.  Power input = AC or DC. (1)
	2711-K6C9				(DH-485)	2711P-B7C22A9P <sup>(1)</sup>						Conformal coat = No.
	2711-K6C9L1					2711P-B7C22D9P						Adapter kit is necessary for drop-in replacement.
	2711-K6C8				DH+	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C8L1				DITT	2711P-B7C22D9P						
	2711-K6C20				EtherNet/IP	2711P-B7C22A9P <sup>(1)</sup>						
	2711-K6C20L1				Edicinet/ii	2711P-B7C22D9P						
	2711-B6C1				Remote I/O	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B6C1L1				nemote i/ 0	2711P-B7C22D9P						
	2711-B6C10					2711P-B7C22A9P <sup>(1)</sup>	<u> </u>					
	2711-B6C10L1				DeviceNet	2711P-B7C22D9P	<u> </u>					
	2711-B6C14				Devicence	2711P-B7C22A9P <sup>(1)</sup>	<u> </u>					
	2711-B6C14L1					2711P-B7C22D9P						
	2711-B6C12				RS-232	2711P-B7C22A9P <sup>(1)</sup>	]					
	2711-B6C12L1				113 232	2711P-B7C22D9P						
	2711-B6C16				RS-232	2711P-B7C22A9P <sup>(1)</sup>	]					
	2711-B6C16L1				(DF1)	2711P-B7C22D9P						

#### PanelView Standard 600 Terminals Primary Replacement Options (continued)

	Pane	View Sta	ndard Ter	minals			Panel\	iew Plus	7 Terminals – F	rimary Rep	lacement 0	ptions
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-B6C15				ControlNet	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B6C15L1				Controllect	2711P-B7C22D9P						
	2711-B6C2					2711P-B7C22A9P <sup>(1)</sup>						
	2711-B6C2L1				DH-485	2711P-B7C22D9P						0 11/1 01 70 (
	2711-B6C3				703	2711P-B7C22A9P <sup>(1)</sup>						PanelView Plus 7 Performance 6.5 in. terminal benefits:
	2711-B6C3L1					2711P-B7C22D9P						<ul><li>Higher resolution</li><li>DLR</li></ul>
	2711-B6C5	192	290	320 x 234		2711P-B7C22A9P <sup>(1)</sup>	142	237	640 x 480	Dual Ethernet	2711P-	Communication = Ethernet. Operator input = keypad and
	2711-B6C5L1	(7.55)	(11.40)	320 X 234	RS-232	2711P-B7C22D9P	(5.59)	(9.33)	040 % 400	ports	RAAK7	touch.  Power input = AC or DC. <sup>(1)</sup>
	2711-B6C9				(DH-485)	2711P-B7C22A9P <sup>(1)</sup>						Conformal coat = No.
	2711-B6C9L1					2711P-B7C22D9P						Adapter kit is necessary for drop-in replacement.
	2711-B6C8				DH+	2711P-B7C22A9P <sup>(1)</sup>						
	2711-B6C8L1				DITT	2711P-B7C22D9P						
	2711-B6C20				EtherNet/IP	2711P-B7C22A9P <sup>(1)</sup>						
600	2711-B6C20L1				Etherwegh	2711P-B7C22D9P						
	2711-T6C1L1				Remote I/O							
	2711-T6C10L1				DeviceNet							
	2711-T6C14L1				Devicence							PanelView Plus 7 Standard 6 in.
	2711-T6C12L1				RS-232							terminal benefits: Higher resolution
	2711-T6C16L1				RS-232 (DF1)							Application limits:  • Max. screen count: 100
	2711-T6C15L1	152 (6.0)	185 (7.28)	320 x 234	ControlNet	2711P-T6C21D8S	123 (4.84)	156 (6.14)	640 x 480	One Ethernet	N/A	<ul><li>Max. alarm messages: 500</li><li>Max. number of controllers: 1</li></ul>
	2711-T6C2L1	(0.0)	(7.20)		DH-485		(4.04)	(0.14)		port		Communication = Ethernet (dual Ethernet ports are
	2711-T6C3L1				DΠ-403							available).  Operator input = only touch.
	2711-T6C5L1				RS-232							Power input = only DC.
	2711-T6C9L1				(DH-485)							Conformal coat = No.
	2711-T6C8L1				DH+							
	2711-T6C20L1				EtherNet/IP							

<sup>(1)</sup> AC power is only available on Series A terminals. DC power is only available on Series B terminals.

#### **PanelView Standard 600 Terminals Secondary Replacement Options**

	Pane	lView Sta	ndard Ter	minals			Panel	View Plus	7 Terminals – S	Secondary F	Replacemen	t Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K6C1				Remote I/O							
	2711-K6C1L1											
	2711-K6C10											
	2711-K6C10L1				DeviceNet							
	2711-K6C14											
	2711-K6C14L1											
	2711-K6C12				RS-232							
	2711-K6C12L1											
	2711-K6C16 2711-K6C16L1				RS-232 (DF1)							
	2711-K6C16L1				. ,							
	2711-K6C15				ControlNet							
	2711-K6C2											
	2711-K6C2L1											
	2711-K6C3				DH-485							PanelView Plus 7 Standard 6.5 in. terminal benefits:
	2711-K6C3L1											Higher resolution Application limits:
	2711-K6C5	192	290			2742 TT624D06	142	184		One		Max. screen count: 100
600	2711-K6C5L1	(7.55)	(11.40)	320 x 234	RS-232	2711P-T7C21D8S	(5.59)	(7.24)	640 x 480	Ethernet port	N/A	Max. alarm messages: 500     Max. number of controllers: 1 Communication = Ethernet (dual)
	2711-K6C9				(DH-485)							Ethernet ports are available).  Operator input = only touch.
	2711-K6C9L1											Power input = only DC.
	2711-K6C8				DH+							Conformal coat = No.
	2711-K6C8L1				DILI							
	2711-K6C20				EtherNet/IP							
	2711-K6C20L1											
	2711-B6C1				Remote I/O							
	2711-B6C1L1											
	2711-B6C10											
	2711-B6C10L1				DeviceNet							
	2711-B6C14											
	2711-B6C14L1 2711-B6C12											
	2711-B6C12 2711-B6C12L1				RS-232							
	2711-B6C12E1				DC 222							
	2711-B6C16L1				RS-232 (DF1)							
	Z/ II DOCTOLI	<u>l</u>		<u>l</u>				l	İ		]	

#### PanelView Standard 600 Terminals Secondary Replacement Options (continued)

	Pane	lView Sta	ndard Ter	minals			Panel	View Plus	7 Terminals – S	Secondary F	Replacemen	t Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-B6C15				ControlNet							
	2711-B6C15L1				Controllec							
	2711-B6C2											
	2711-B6C2L1				DH-485							PanelView Plus 7 Standard 6.5 in.
	2711-B6C3				DII 103							terminal benefits: Higher resolution
	2711-B6C3L1											Application limits:  • Max. screen count: 100
	2711-B6C5	192	290	320 x 234		2711P-T7C21D8S	142	184	640 x 480	One Ethernet	N/A	Max. alarm messages: 500
	2711-B6C5L1	(7.55)	(11.40)	320 X 23 1	RS-232	27111 17 (2100)	(5.59)	(7.24)	0 10 X 100	port	10,71	Max. number of controllers: 1 Communication = Ethernet (dual)
	2711-B6C9				(DH-485)							Ethernet ports are available).  Operator input = only touch.
	2711-B6C9L1											Power input = only DC. Conformal coat = No.
	2711-B6C8				DH+							Comornial coat = No.
	2711-B6C8L1											
	2711-B6C20				EtherNet/IP							
600	2711-B6C20L1											
	2711-T6C1L1				Remote I/O							
	2711-T6C10L1				DeviceNet							
	2711-T6C14L1											
	2711-T6C12L1				RS-232							PanelView Plus 7 Performance 6.5 in. terminal benefits:
	2711-T6C16L1				RS-232 (DF1)							Higher resolution     DLR
	2711-T6C15L1	152 (6.0)	185 (7.28)	320 x 234	ControlNet	2711P-T7C22D9P	142 (5.59)	184 (7.24)	640 x 480	Dual Ethernet	N/A	Communication = Ethernet. Operator input = keypad and
	2711-T6C2L1	(0.0)	(7.20)		DH-485		(3.39)	(7.24)		ports		touch.  Power input = AC or DC. (1)
	2711-T6C3L1				DII-403							Conformal coat = Yes <sup>(2)</sup> Adapter kit is necessary for drop-
	2711-T6C5L1				RS-232							in replacement.
	2711-T6C9L1				(DH-485)							
	2711-T6C8L1				DH+							
	2711-T6C20L1				EtherNet/IP							

<sup>(1)</sup> AC power is only available on Series A terminals. DC power is only available on Series B terminals.

<sup>(2)</sup> Conformal coating is available for all DC-power, touch terminals. To order a terminal that is conformal-coated, add K to the end of a DC-power, touch catalog number; for example, 2711P-T7C22D9PK.

#### **PanelView Standard 900 Terminals Conversions**

See the tables in this section for primary and secondary conversions for PanelView Standard 900 terminals.

#### **PanelView Standard 900 Terminals Primary Replacement Options**

	Panel	View Sta	ndard Ter	minals			Panel	View Plus	7 Terminals –	Primary Re	placement (	Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K9A1				Remote I/O	2711P-B10C22A9P						
	2711-K9A1L1				Kelliote I/O	2711P-B10C22D9P						
	2711-K9A10					2711P-B10C22A9P						
	2711-K9A10L1				DeviceNet	2711P-B10C22D9P						
	2711-K9A14L1					2711P-B10C22D9P						
	2711-K9A12					2711P-B10C22A9P						
	2711-K9A12L1					2711P-B10C22D9P						
	2711-K9A5				RS-232	2711P-B10C22A9P						
	2711-K9A5L1				N3-232	2711P-B10C22D9P						
	2711-K9A9			640 x 400		2711P-B10C22A9P						
	2711-K9A9L1					2711P-B10C22D9P						
	2711-K9A15				CombuelNet	2711P-B10C22A9P						
	2711-K9A15L1				ControlNet	2711P-B10C22D9P						
	2711-K9A2					2711P-B10C22A9P						
	2711-K9A2L1				DII 40E	2711P-B10C22D9P						PanelView Plus 7 Performance 10.4 in. terminal benefits:
	2711-K9A3				DH-485	2711P-B10C22A9P						<ul><li>Higher resolution</li><li>DLR</li></ul>
000	2711-K9A3L1	249	406			2711P-B10C22D9P	224	335	000 (00	Dual	2711P-	Communication = Ethernet.
900	2711-K9A8	(9.8)	(15.97)		DIL	2711P-B10C22A9P	(8.82)	(13.19)	800 x 600	Ethernet ports	RAAK10	Operator input = keypad and touch.
	2711-K9A8L1				DH+	2711P-B10C22D9P						Power input = AC or DC. <sup>(1)</sup> Conformal coat = No.
	2711-K9C1				Damata I/O	2711P-B10C22A9P						Adapter kit is necessary for drop-in replacement.
	2711-K9C1L1				Remote I/O	2711P-B10C22D9P						arop in replacements
	2711-K9C10					2711P-B10C22A9P						
	2711-K9C10L1				DeviceNet	2711P-B10C22D9P						
	2711-K9C14				Devicemen	2711P-B10C22A9P						
	2711-K9C14L1					2711P-B10C22D9P						
	2711-K9C12					2711P-B10C22A9P						
	2711-K9C12L1			640 x 480	RS-232	2711P-B10C22D9P						
	2711-K9C9				K3-232	2711P-B10C22A9P						
	2711-K9C9L1					2711P-B10C22D9P						
	2711-K9C16				RS-232	2711P-B10C22A9P						
	2711-K9C16L1	1			(DF1)	2711P-B10C22D9P	•					
	2711-K9C15	1			ControlNet	2711P-B10C22A9P						
	2711-K9C15L1	1			ControlNet	2711P-B10C22D9P	•					
	2711-K9C3				DH-485	2711P-B10C22A9P						

#### PanelView Standard 900 Terminals Primary Replacement Options (continued)

2711-89C81   2711-9C101   2711-9AS10   271		Pane	View Sta	ndard Ter	minals			Panel	View Plus	7 Terminals –	Primary Re	placement	Options
2711-85(3.1)   2711-85(3.1)   2711-85(3.23)													
2711-89C81   2711-9C101   2711-9AS10   271	Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)		Comm.	Kit Cat.	Notes
2711-90.03		2711-K9C3L1				DH-485	2711P-B10C22D9P						PanelView Plus 7 Performance
2711-96/21   2711-96/2269   2711-96/2269		2711-K9C8				DH+	2711P-B10C22A9P						Higher resolution
2711-93(2)   2711-93(1)   271		2711-K9C8L1		406			2711P-B10C22D9P		335			2711P₋	Communication = Ethernet.
2711-9301		2711-K9C20			640 x 480		2711P-B10C22A9P						touch.
2711-79A1U1   2711-79A10   2711-79A10   2711-79A10   2711-79A10   2711-79A10   2711-79A10   2711-79A10   2711-79A11   27		2711-K9C20L1				Ethernet	2711P-B10C22D9P						Conformal coat = No. Adapter kit is necessary for
2711-79AL1		2711-T9A1				D	2711P-T10C22A9P						
2711-19410L1   2711-19412   2711-19414   2711-19412   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2711-19414   2		2711-T9A1L1				Kemote I/U	2711P-T10C22D9P						
2711-79A14L1   2711-79A12   2711-79A12   2711-79A15   2711-79A2   2711-79C2209P   2711-710C2209P   2711-7		2711-T9A10					2711P-T10C22A9P						
2711-9A12   2711-9A5   2711-9C12   27		2711-T9A10L1				DeviceNet	2711P-T10C22D9P						
2711-79A12L1   2711-79A5   2711-79C12D9P   2711-79C12D9P		2711-T9A14L1					2711P-T10C22D9P						
Pack		2711-T9A12					2711P-T10C22A9P						
PanelView Plus 7 Performant   PanelView Plus Plus Plus Plus Plus Plus Plus Plus		2711-T9A12L1					2711P-T10C22D9P						
2711-79A5L1   2711-79A9L1   2711-79C10L1		2711-T9A5				RS-232	2711P-T10C22A9P						
2711-79A9L1   249 (9.8)   2711-79A15L1   2711-79A15L1   2711-79A2   249 (9.8)   2711-79A2   2711-79A2   2711-79A3   2711-79A3L1   2711-79A8   2711-79A8L1   2711-79C10   271		2711-T9A5L1				11.5 2.52	2711P-T10C22D9P						
Parelly   Pare		2711-T9A9			640 x 400		2711P-T10C22A9P						
2711-F3A15   249   (9.8)   2711-F3A15   2711-F3A15   2711-F3A15   2711-F3A21   27		2711-T9A9L1					2711P-T10C22D9P				Dual		
2711-79A2   2711-79A2   2711-79A2   2711-79A2   2711-79A3   2711-79A3   2711-79A8   2711-79A8   2711-79A8   2711-79C12	900	2711-T9A15				ControlNet	2711P-T10C22A9P			800 x 600	Ethernet		
2711-79A2L1   336 (13.24)   2711-710C22D9P   269 (10.59)   2711-710C22D9P   2711-710C2D9P   2711-710C2D		2711-T9A15L1					2711P-T10C22D9P				ports		10.4 in. terminal benefits:
DH-485   2711-T10C22A9P   2711-T10C2A9P   2711-T10C2A													
2711-T9A3L1   2711-T10C22D9P   2711P-T10C22D9P   2711P-T10C2D9P   2711P-T10C2						DH-485		†					
2711-T9A8   2711P-T10C22A9P   2711P-T10C2A9P   2711P-T10CAAP   27				(13.24)				<u> </u>	(10.55)			IIAAIIO	Power input = AC or DC. $^{(1)}$
DH+													Adapter kit is necessary for
2711-T9C1 2711-T9C10 2711-T9C10 2711-T9C10 2711-T9C10 2711-T9C14 2711-T9C14 2711-T9C12 2711-T9C12 2711-T9C12 2711-T9C16 Remote I/O 2711P-T10C22A9P						DH+		<u> </u>					drop-in replacement.
Remote I/O   2711-T9C10   2711-T9C10   2711-T10C22D9P   2711-T10C2D9P   2711-T10C2D													
2711-T9C10 2711-T9C10L1 2711-T9C14 2711-T9C14 2711-T9C12 2711-T9C12 2711-T9C12 2711-T9C16 2711-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P						Remote I/O							
2711-T9C10L1   DeviceNet   2711P-T10C22D9P   2711P-T10C2D9P   2711P-T10CDP   2711P-T10CDP   2711P-T10CDP   2711P-T10CDP   2711P-T10CDP   27													
DeviceNet   2711-T9C14   640 x 480   2711P-T10C22A9P   2711P-T10C22D9P   2711P-T10C22D9P   2711P-T10C22D9P   2711P-T10C2D9P   2711P-T10C2DP   2711P-T10CDP   2711P-T10CDP   2711P-T10CDP   2711P-T10CDP   2711P-T10CDP   27													
2711-T9C14L1 2711-T9C12 2711-T9C12 2711-T9C12L1 2711-T9C16  RS-232 RS-232 2711P-T10C22A9P 2711P-T10C22A9P 2711P-T10C22A9P						DeviceNet							
2711-T9C12 2711-T9C12L1 2711-T9C16  RS-232 2711P-T10C22A9P 2711P-T10C22A9P (DE1)					640 x 480								
2711-T9C12L1													
2711-T9C16 RS-232 2711P-T10C22A9P						RS-232		<del> </del>					
N)-232 (NE1)			}			BC-252							
Z/11-17C10L1           ' '   Z/11F-110CZZUYF		2711-T9C16L1					2711P-T10C22D9P	†					
2711-T9C15 ControlNet 2711P-T10C22A9P		2711-T9C15	•			ControlNet	2711P-T10C22A9P						

#### PanelView Standard 900 Terminals Primary Replacement Options (continued)

	Pane	View Sta	ndard Ter	minals			Pane	lView Plus	7 Terminals –	Primary Re	placement	Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-T9C15L1				ControlNet	2711P-T10C22D9P						
	2711-T9C3				DH-485	2711P-T10C22A9P						PanelView Plus 7 Performance
	2711-T9C3L1				νπ- <del>4</del> οο	2711P-T10C22D9P						10.4 in. terminal benefits:
	2711-T9C9				RS-232	2711P-T10C22A9P				Dual		Higher resolution     DLR
900	2711-T9C9L1	249 (9.8)	336 (13.24)	640 x 480	(DH-485)	2711P-T10C22D9P	224 (8.82)	269 (10.59)	800 x 600	Ethernet	2711P- RAAT10	Communication = Ethernet. Operator input = only touch.
	2711-T9C8	, , ,	,		DH+	2711P-T10C22A9P	,	,,		ports		Power input = AC or DC. (1) Conformal coat = Yes (2)
	2711-T9C8L1				νπ÷	2711P-T10C22D9P						Adapter kit is necessary for
	2711-T9C20				Fals award	2711P-T10C22A9P						drop-in replacement.
	2711-T9C20L1				Ethernet	2711P-T10C22D9P						

<sup>(1)</sup> AC power is only available on Series A terminals. DC power is only available on Series B terminals.

<sup>(2)</sup> Conformal coating is available for all DC-power, touch terminals. To order a terminal that is conformal-coated, add K to the end of a DC-power, touch catalog number; for example, 2711P-T10C22D9PK.

#### **PanelView Standard 900 Terminals Secondary Replacement Options**

-	Panel	View Sta	ndard Ter	minals		PanelView Plus 7 Terminals – Secondary Replacement Options							
		Panel C Dimens					Panel Cu Dimensi						
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes	
	2711-K9A1				Remote I/O								
	2711-K9A1L1												
	2711-K9A10	-			DeviceNet								
	2711-K9A10L1												
	2711-K9A14L1												
	2711-K9A12												
	2711-K9A12L1 2711-K9A5												
	2711-K9A5 2711-K9A5L1				RS-232	2711P-T10C21D8S							
	2711-K9A9			640 x 400									
	2711-K9A9L1			310 / 100									
	2711-K9A15												
	2711-K9A15L1				ControlNet								
	2711-K9A2						224 (8.82)	269 (10.59)				PanelView Plus 7 Standard 10.4 in. terminal benefits: Higher resolution Application limits: • Max. screen count: 100 • Max. alarm messages: 500 • Max. number of controllers: 1 Communication = Ethernet (dual Ethernet ports are available). Operator input = only touch. Power input = only DC. Conformal coat = No.	
	2711-K9A2L1				DH-485								
	2711-K9A3				לטר ווכ								
900	2711-K9A3L1	249	406						800 x 600	One Ethernet	N/A		
700	2711-K9A8	(9.8)	(15.97)		DH+					port			
	2711-K9A8L1												
	2711-K9C1				Remote I/O								
	2711-K9C1L1												
	2711-K9C10												
	2711-K9C10L1 2711-K9C14				DeviceNet								
	2711-K9C14 2711-K9C14L1												
	2711-K9C14L1 2711-K9C12												
	2711-K9C12L1			640 x 480									
	2711-K9C9				RS-232								
	2711-K9C9L1												
	2711-K9C16				RS-232								
	2711-K9C16L1				(DF1)								
	2711-K9C15				ControlNet								
	2711-K9C15L1				ControlNet								
	2711-K9C3				DH-485								

#### PanelView Standard 900 Terminals Secondary Replacement Options (continued)

	PanelView Standard Terminals						PanelV	iew Plus	7 Terminals – S	econdary R	eplacement	Options
		Panel C Dimens					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K9C3L1				DH-485							
	2711-K9C8				DH+							
	2711-K9C8L1		406 (15.97)	640 x 480	DII 1							
	2711-K9C20				Ethernet							
	2711-K9C20L1											
	2711-T9A1				Remote I/O							
	2711-T9A1L1											
	2711-T9A10				DavisaNat							
	2711-T9A10L1 2711-T9A14L1				DeviceNet							
	2711-19A14L1 2711-T9A12											
	2711-19A12 2711-T9A12L1											
	2711-T9A5											
	2711-T9A5L1				RS-232							
	2711-T9A9	1		640 x 400								PanelView Plus 7 Standard 10.4 in. terminal benefits:
	2711-T9A9L1											Higher resolution Application limits:
	2711-T9A15				C . IN .					0		Max. screen count: 100     Max. alarm messages: 500
900	2711-T9A15L1	249 (9.8)			ControlNet	2711P-T10C21D8S	224 (8.82)	269 (10.59)	800 x 600	One Ethernet	N/A	Max. number of controllers: 1  Communication = Ethernet
	2711-T9A2	, , , ,					,	, ,,,,		port		(dual Ethernet ports are
	2711-T9A2L1		336		DH-485							available). Operator input = only touch.
	2711-T9A3		(13.24)		707							Power input = only DC. Conformal coat = No.
	2711-T9A3L1											
	2711-T9A8				DH+							
	2711-T9A8L1											
	2711-T9C1				Remote I/O							
	2711-T9C1L1											
	2711-T9C10 2711-T9C10L1											
	2711-19C10L1 2711-T9C14				DeviceNet							
	2711-T9C14 2711-T9C14L1			640 x 480								
	2711-T9C12			3.0% 100								
	2711-T9C12L1				RS-232							
	2711-T9C16				RS-232							
	2711-T9C16L1				(DF1)							
	2711-T9C15				ControlNet							

#### PanelView Standard 900 Terminals Secondary Replacement Options (continued)

-	Panel	ndard Ter	minals		PanelView Plus 7 Terminals – Secondary Replacement Options							
		Panel C Dimens					Panel Cutout Dimensions					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-T9C15L1				ControlNet							D 11/2 DI 7.6. I I
	2711-T9C3	249 (9.8)			DH-485		PanelView Plus 7 Standard 10.4 in. terminal benefits:					
	2711-T9C3L1				υπ- <del>4</del> 03						N/A	Higher resolution Application limits:  • Max. screen count: 100  • Max. alarm messages: 500  • Max. number of controllers: 1 Communication = Ethernet (dual Ethernet ports are available). Operator input = only touch. Power input = only DC. Conformal coat = No.
	2711-T9C9				RS-232				000	One		
900	2711-T9C9L1		336 (13.24)	640 x 480	(DH-485)	2711P-T10C21D8S	224 (8.82)	269 (10.59)	800 x 600	Ethernet		
	2711-T9C8				DIL		,	,,		port		
	2711-T9C8L1				DH+							
	2711-T9C20				F414							
	2711-T9C20L1				Ethernet							Comornia Coat — NO.

#### **PanelView Standard 1000 Terminals Conversions**

See the tables in this section for primary and secondary conversions for PanelView Standard 1000 terminals.

#### **PanelView Standard 1000 Terminals Primary Replacement Options**

-	Pane	IView Star	ndard Tern	ninals			PanelVi	ew Plus 7	Terminals – Pri	mary Repla	acement Op	tions
		Panel Cu Dimensi					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K10C1				Remote I/O	2711P-T12W22A9P						
	2711-K10C1L1					2711P-T12W22D9P						
	2711-K10C10					2711P-T12W22A9P						
	2711-K10C10L1				DeviceNet	2711P-T12W22D9P						
	2711-K10C14				Devicemen	2711P-T12W22A9P						
	2711-K10C14L1					2711P-T12W22D9P						
	2711-K10C12				DC 222	2711P-T12W22A9P						
	2711-K10C12L1				RS-232	2711P-T12W22D9P						PanelView Plus 7 Performance 12.1 in. terminal benefits: • Wide screen has more usable screen area • Higher resolution • DLR Communication = Ethernet. Operator input = only touch. Power input = AC or DC. (1) Conformal coat = Yes (2) Adapter kit is necessary for drop-in replacement.
	2711-K10C16				RS-232	2711P-T12W22A9P						
	2711-K10C16L1				(DF1)	2711P-T12W22D9P						
	2711-K10C15					2711P-T12W22A9P						
	2711-K10C15L1				ControlNet	2711P-T12W22D9P						
	2711-K10C3					2711P-T12W22A9P	218 (8.58)					
	2711-K10C3L1				DH-485	2711P-T12W22D9P						
	2711-K10C9			640 x 480	RS-232 (DH-485)	2711P-T12W22A9P						
	2711-K10C9L1					2711P-T12W22D9P						
	2711-K10C8	282	423		DH+	2711P-T12W22A9P		312 (12.28)	1280 x 800	Dual	2711P-	
1000	2711-K10C8L1	(11.11)	(16.64)			2711P-T12W22D9P				Ethernet ports	RAAT12K	
	2711-K10C20				Ethernet	2711P-T12W22A9P						
	2711-K10C20L1					2711P-T12W22D9P						
	2711-K10G1					2711P-T12W22A9P						
	2711-K10G1L1				Remote I/O	2711P-T12W22D9P						
	2711-K10G10					2711P-T12W22A9P	-					
	2711-K10G10L1					2711P-T12W22D9P						
	2711-K10G14				DeviceNet	2711P-T12W22A9P						
	2711-K10G14L1					2711P-T12W22D9P						
	2711-K10G12	-				2711P-T12W22A9P	1					
	2711-K10G12L1				RS-232	2711P-T12W22D9P	1					
	2711-K10G16				RS-232	2711P-T12W22A9P	1					
	2711-K10G16L1				(DF1)	2711P-T12W22D9P	1					
	2711-K10G15					2711P-T12W22A9P						
	2711-K10G15L1				ControlNet	2711P-T12W22D9P						
	2711-K10G3					2711P-T12W22A9P						
	2711-K10G3L1				DH-485	2711P-T12W22D9P	1					

#### PanelView Standard 1000 Terminals Primary Replacement Options (continued)

	Pane	lView Star	ndard Tern	ninals		PanelView Plus 7 Terminals – Primary Replacement Options							
		Panel Cu Dimensi					Panel Cu Dimensi						
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes	
	2711-K10G9				RS-232	2711P-T12W22A9P							
	2711-K10G9L1				(DH-485)	2711P-T12W22D9P							
	2711-K10G8		423		DH+	2711P-T12W22A9P					2711P-	PanelView Plus 7	
	2711-K10G8L1		(16.64)			2711P-T12W22D9P					RAAT12K		
	2711-K10G20				Ethernet	2711P-T12W22A9P							
	2711-K10G20L1				Ethernet	2711P-T12W22D9P							
	2711-T10C1				Remote I/O	2711P-T12W22A9P							
	2711-T10C1L1				helilote i/O	2711P-T12W22D9P							
	2711-T10C10					2711P-T12W22A9P							
	2711-T10C10L1				DavisaNat	2711P-T12W22D9P							
	2711-T10C14				DeviceNet	2711P-T12W22A9P							
	2711-T10C14L1					2711P-T12W22D9P	218 (8.58)						
	2711-T10C12				RS-232	2711P-T12W22A9P							
	2711-T10C12L1					2711P-T12W22D9P							
	2711-T10C16				RS-232	2711P-T12W22A9P							
	2711-T10C16L1				(DF1)	2711P-T12W22D9P						Performance 12.1 in. terminal benefits:	
	2711-T10C15				ControlNet	2711P-T12W22A9P						Higher resolution     DLR	
1000	2711-T10C15L1	282	370 (14.58)	640 x 480		2711P-T12W22D9P		312 (12.28)	1280 x 800	Dual Ethernet		Communication = Ethernet. Operator input = only touch. Power input = AC or DC. (1) Conformal coat = Yes(2) Adapter kit is necessary for drop-in replacement.	
	2711-T10C3	(11.11)			DH-485	2711P-T12W22A9P				ports			
	2711-T10C3L1					2711P-T12W22D9P					2711P- RAAT12		
	2711-T10C9				RS-232 (DH-485)	2711P-T12W22A9P							
	2711-T10C9L1					2711P-T12W22D9P							
	2711-T10C8				DH+	2711P-T12W22A9P							
	2711-T10C8L1					2711P-T12W22D9P							
	2711-T10C20				Ethernet	2711P-T12W22A9P							
	2711-T10C20L1					2711P-T12W22D9P							
	2711-T10G1				Remote I/O	2711P-T12W22A9P							
	2711-T10G1L1				Nemote 1/0	2711P-T12W22D9P							
	2711-T10G10					2711P-T12W22A9P							
	2711-T10G10L1				DeviceNet	2711P-T12W22D9P							
	2711-T10G14				Devicemen	2711P-T12W22A9P							
	2711-T10G14L1					2711P-T12W22D9P							
	2711-T10G12				RS-232	2711P-T12W22A9P							
	2711-T10G12L1					2711P-T12W22D9P							
	2711-T10G16				RS-232 (DF1)	2711P-T12W22A9P							

#### PanelView Standard 1000 Terminals Primary Replacement Options (continued)

	PanelView Standard Terminals						PanelVi	ew Plus 7	Terminals – Pr	imary Repla	acement Op	tions
		Panel Cu Dimensi					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-T10G16L1				RS-232 (DF1)	2711P-T12W22D9P	218 (8.58)	312 (12.28)	1280 x 800		2711P-	PanelView Plus 7 Performance 12.1 in. terminal benefits: • Higher resolution • DLR Communication = Ethernet. Operator input = only touch. Power input = AC or DC. (1) Conformal coat = Yes (2) Adapter kit is necessary for drop-in replacement.
	2711-T10G15				ControlNet	2711P-T12W22A9P				Dual Ethernet ports		
	2711-T10G15L1					2711P-T12W22D9P						
	2711-T10G3				DH-485	2711P-T12W22A9P						
	2711-T10G3L1	282	370			2711P-T12W22D9P						
1000	2711-T10G9	(11.11)	(14.58)	640 x 480	RS-232	2711P-T12W22A9P					RAAT12	
	2711-T10G9L1			(DH-4	(DH-485)	2711P-T12W22D9P						
	2711-T10G8				DH+	2711P-T12W22A9P						
	2711-T10G8L1				DIIT	2711P-T12W22D9P						
	2711-T10G20				Ethernet	2711P-T12W22A9P						
	2711-T10G20L1					2711P-T12W22D9P						

<sup>(1)</sup> AC power is only available on Series A terminals. DC power is only available on Series B terminals.

<sup>(2)</sup> Conformal coating is available for all DC-power, touch terminals. To order a terminal that is conformal-coated, add K to the end of a DC-power, touch catalog number; for example, 2711P-T12W22D9PK.

#### PanelView Standard 1000 Terminals Secondary Replacement Options

	Pane	lView Star	ndard Tern	ninals			PanelVie	w Plus 7 T	erminals – Seco	ondary Rep	lacement 0 <sub>1</sub>	ptions
		Panel Cu Dimensi					Panel Co Dimens					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K10C1				Remote I/O	2711P-B15C22A9P						
	2711-K10C1L1				nemote 1/0	2711P-B15C22D9P						
	2711-K10C10					2711P-B15C22A9P						
	2711-K10C10L1				DeviceNet	2711P-B15C22D9P						
	2711-K10C14				Devicence	2711P-B15C22A9P						
	2711-K10C14L1					2711P-B15C22D9P						
	2711-K10C12				RS-232	2711P-B15C22A9P						
	2711-K10C12L1				113-232	2711P-B15C22D9P						
	2711-K10C16				RS-232	2711P-B15C22A9P						
	2711-K10C16L1				(DF1)	2711P-B15C22D9P						
	2711-K10C15				Combine IN ob	2711P-B15C22A9P						
	2711-K10C15L1				ControlNet	2711P-B15C22D9P						
	2711-K10C3				DII 405	2711P-B15C22A9P						
	2711-K10C3L1				DH-485	2711P-B15C22D9P						PanelView Plus 7 Performance 15 in.
	2711-K10C9				RS-232	2711P-B15C22A9P						terminal benefits:  • Wide screen has more
	2711-K10C9L1				(DH-485)	2711P-B15C22D9P						usable screen area  • Higher resolution
1000	2711-K10C8	282	423		DII.	2711P-B15C22A9P	290	418	1024 760	Dual		• DLR
1000	2711-K10C8L1	(11.11)	(16.64)	640 x 480	DH+	2711P-B15C22D9P	(11.42)	(16.46)	1024 x 768	Ethernet ports	N/A	Communication = Ethernet.
	2711-K10C20				Fall	2711P-B15C22A9P						Operator input = The 15 in. terminal is listed as
	2711-K10C20L1				Ethernet	2711P-B15C22D9P						secondary replacement if you require a keypad.
	2711-K10G1				D . 1/0	2711P-B15C22A9P						Power input = AC or DC. <sup>(1)</sup> Conformal coat = Yes <sup>(2)</sup>
	2711-K10G1L1				Remote I/O	2711P-B15C22D9P						Contonnal Coat — les
	2711-K10G10					2711P-B15C22A9P						
	2711-K10G10L1					2711P-B15C22D9P						
	2711-K10G14				DeviceNet	2711P-B15C22A9P						
	2711-K10G14L1					2711P-B15C22D9P						
	2711-K10G12				25 222	2711P-B15C22A9P						
	2711-K10G12L1				RS-232	2711P-B15C22D9P						
	2711-K10G16				RS-232	2711P-B15C22A9P						
	2711-K10G16L1				(DF1)	2711P-B15C22D9P						
	2711-K10G15	1				2711P-B15C22A9P	1					
	2711-K10G15L1			ControlNet	2711P-B15C22D9P	-						
	2711-K10G3	1			BU 45-	2711P-B15C22A9P	1					
	2711-K10G3L1	1			DH-485	2711P-B15C22D9P	1					

#### PanelView Standard 1000 Terminals Secondary Replacement Options (continued)

	Pane	lView Star	ndard Tern	ninals			PanelVie	w Plus 7 T	erminals – Seco	ondary Rep	lacement 0	ptions
		Panel Cu Dimensi	itout ons				Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-K10G9				RS-232	2711P-B15C22A9P						PanelView Plus 7 Performance 15 in.
	2711-K10G9L1				(DH-485)	2711P-B15C22D9P						terminal benefits:  • Higher resolution
	2711-K10G8				DH+	2711P-B15C22A9P						• DLR
	2711-K10G8L1		423 (16.64)			2711P-B15C22D9P	290 (11.42)	418 (16.46)	1024 x 768	Dual Ethernet	N/A	Communication = Ethernet.
	2711-K10G20		(10.04)			2711P-B15C22A9P	(11.42)	(10.40)		ports		Operator input = The 15 in. terminal is listed as
	2711-K10G20L1				Ethernet	2711P-B15C22D9P						secondary replacement if you require a keypad. Power input = AC or DC. <sup>(1)</sup> Conformal coat = Yes <sup>(2)</sup>
	2711-T10C1				Damata I/O							
	2711-T10C1L1				Remote I/O							
	2711-T10C10											
	2711-T10C10L1				DeviceNet							
	2711-T10C14				Devicence							
	2711-T10C14L1											
	2711-T10C12				RS-232							
	2711-T10C12L1				252							
	2711-T10C16				RS-232							
	2711-T10C16L1				(DF1)							
1000	2711-T10C15	282 (11.11)		640 x 480	ControlNet							
	2711-T10C15L1	(11.11)										
	2711-T10C3				DH-485							
	2711-T10C3L1											
	2711-T10C9		370 (14.58)		RS-232 (DH-485)			N	o secondary opti	on available.		
	2711-T10C9L1				(011-103)							
	2711-T10C8				DH+							
	2711-T10C8L1											
	2711-T10C20				Ethernet							
	2711-T10C20L1 2711-T10G1											
	2711-110G1 2711-T10G1L1				Remote I/O							
	2711-T10G1E1											
	2711-T10G10L1											
	2711-T10G10E1				DeviceNet							
	2711-T10G14L1											
	2711-T10G12											
	2711-T10G12L1				RS-232							
	2711-T10G16				RS-232							
	2/11-110010				(DF1)							

#### PanelView Standard 1000 Terminals Secondary Replacement Options (continued)

	Pane	View Stan	dard Tern	ninals			PanelViev	v Plus 7 To	erminals – Seco	ondary Rep	lacement 0	ptions
		Panel Cu Dimensi					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-T10G16L1				RS-232 (DF1)							
	2711-T10G15				ControlNet							
	2711-T10G15L1				Controllect							
	2711-T10G3				DH-485							
	2711-T10G3L1	282	370		DI1-403							
1000	2711-T10G9	(11.11)	(14.58)	640 x 480	RS-232			N	o secondary opti	on available.		
	2711-T10G9L1				(DH-485)							
	2711-T10G8				DH+							
	2711-T10G8L1				DIIT							
	2711-T10G20				Ethernet							
	2711-T10G20L1				Luiciliet							

<sup>(1)</sup> AC power is only available on Series A terminals. DC power is only available on Series B terminals.

<sup>(2)</sup> Conformal coating is available for the DC power, 15 in. combination keypad/touch terminals. To order a terminal that is conformal-coated, add K to the end of a DC-power catalog number; for example, 2711P-B15C22D9PK.

#### **PanelView Standard 1400 Terminals Conversions**

See the tables in this section for primary and secondary conversions for PanelView Standard 1400 terminals.

#### **PanelView Standard 1400 Terminals Primary Replacement Options**

	Pan	elView Sta	ndard Ter	minals			Panel\	iew Plus	7 Terminals – P	rimary Rep	lacement 0	ptions
		Panel Cu Dimensi					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-T14C1				Remote I/O							
	2711-T14C14				DeviceNet							
	2711-T14C10				Devicence							PanelView Plus 7
	2711-T14C12				RS-232							Performance 15 in. terminal benefits:
	2711-T14C16		441		RS-232 (DF1)	2711P-T15C22A9P		353			2711P-	Higher resolution     DLR Communication = Ethernet.
	2711-T14C15		(17.37)		ControlNet	2/1117-113(22/49)		(13.9)			RAAT15	Operator input = only touch.
	2711-T14C3				DH-485							Power input = only AC. Conformal coat = No.
	2711-T14C9				RS-232 (DH-485)							Adapter kit is necessary for drop-in replacement.
	2711-T14C8				DH+							
1400	2711-T14C20	355		800 x 600	Ethernet		290		1024 x 768	Dual Ethernet		
1400	2711-K14C1	(13.97)		000 X 000	Remote I/O		(11.42)		1024 X 700	ports		
	2711-K14C14				DeviceNet							
	2711-K14C10				Devicence							PanelView Plus 7 Performance 15 in. terminal
	2711-K14C12				RS-232							benefits:  • Higher resolution
	2711-K14C16		483		RS-232 (DF1)	2711P-B15C22A9P		418			2711P-	• DLR Communication = Ethernet.
	2711-K14C15		(19.0)		ControlNet	2/11P-B13C22A9P		(16.46)			RAAK15	Operator input = keypad and touch.
	2711-K14C3				DH-485							Power input = only AC. Conformal coat = No.
	2711-K14C9				RS-232 (DH-485)							Adapter kit is necessary for drop-in replacement.
	2711-K14C8		<u> </u>	DH+	1						. '	
	2711-K14C20				Ethernet							

#### **PanelView Standard 1400 Terminals Secondary Replacement Options**

	Pan	elView Sta	ındard Ter	minals			PanelV	iew Plus 7	Terminals – S	econdary R	eplacemen	t Options
		Panel Cu Dimensi					Panel Cu Dimensi	itout ons				
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711-T14C1				Remote I/O							
	2711-T14C14				DeviceNet							
	2711-T14C10				Devicence							
	2711-T14C12				RS-232							
	2711-T14C16		441		RS-232 (DF1)							
	2711-T14C15		(17.37)		ControlNet							
	2711-T14C3				DH-485							2 115 21 -5: 1
	2711-T14C9				RS-232 (DH-485)							PanelView Plus 7 Standard 15 in. terminal benefits: Higher resolution
	2711-T14C8				DH+							Application limits:  • Max. screen count: 100
1400	2711-T14C20	355		800 x 600	Ethernet	2711P-T15C21D8S	290	353	1024 x 768	One Ethernet	N/A	Max. alarm messages: 500     Max. number of controllers: 1
1400	2711-K14C1	(13.97)		- 000 x 000	Remote I/O	2/1117-113(21063	(11.42)	(13.90)	1024 X 700	port	IN/A	Communication = Ethernet
	2711-K14C14				DeviceNet							(dual Ethernet ports are available).
	2711-K14C10				Devicenet							Operator input = only touch. Power input = only DC.
	2711-K14C12				RS-232							Conformal coat = No.
	2711-K14C16		483		RS-232 (DF1)							
	2711-K14C15		(19.0)		ControlNet							
	2711-K14C3				DH-485	<b>*</b>						
	2711-K14C9				RS-232 (DH-485)							
	2711-K14C8			<u> </u>	DH+	1						
	2711-K14C20	1			Ethernet							

#### PanelView Enhanced 1000e, 1200e, 1400e Terminals Conversions

See the tables in this section for primary and secondary conversions for PanelView Enhanced 1000e, 1200e, 1400e terminals.

#### PanelView Enhanced 1000e, 1200e, 1400e Terminals Primary Replacement Options

	Pane	lView Sta	ndard Ter	minals		PanelView Plus 7 Terminals – Primary Replacement Options						
		Panel Cu Dimensi					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711E-K10C15		423		ControlNet						2711P- RAAT12K	PanelView Plus 7 Performance 12.1 in.
1000e	2711E-K10C6	282	(16.64)	640 x 480	Remote I/O	2711P-	218	312	1280 x 800	Dual Ethernet	(keyboard)	terminals benefits:  • Wide screen has more
10006	2711E-T10C15	(11.11)	370	040 X 400	ControlNet	T12W22A9P	(8.58)	(12.28)	1200 X 000	ports	2711P- RAAT12	usable screen area
	2711E-T10C6		(14.58)		Remote I/O						(touch)	Higher resolution     DLR
	2711E-K12C6	355 (13.97)	483 (19.0)		Remote I/O							Communication = Ethernet. Operator input = only
1200e	2711E-T12C4	342 (13.50)	351 (13.8)	800 x 600	RS-232	2711P- T12W22A9P	218 (8.58)	312 (12.28)	1280 x 800	Dual Ethernet ports	N/A	touch.  Power input = AC.  Conformal coat = No.  Adapter kit is necessary for drop-in replacement for 1000e terminals.
	2711E-K14C15		483		ControlNet	2711P-B15C22A9P		353			2711P-	PanelView Plus 7 Performance 15 in.
	2711E-K14C6		(19.0)		Remote I/O	27111-D13C22A31		(13.9)			RAAK15	terminal benefits:
	2711E-T14C15				ControlNet							Higher resolution     DLR
1400e	2711E-T14C6	355 (13.97)	442 (17.38)	800 x 600	Remote I/O	2711P-T15C22A9P	290 (11.42)	418 (16.46)	1024 x 768	Dual Ethernet ports	2711P- RAAT15	Communication = Ethernet. Operator input = keypad and touch. Power input = AC. Conformal coat = No. Adapter kit is necessary for drop-in replacement.

	Pane	lView Sta	ndard Ter	minals			PanelVi	ew Plus 7	Terminals – Se	condary Re	placement Op	tions
		Panel Cu Dimensi					Panel Cu Dimensi					
Model	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Cat. No.	Height mm (in.)	Width mm (in.)	Display Resolution	Comm.	Adapter Kit Cat. No.	Notes
	2711E-K10C15		423		ControlNet	· 2711P-B15C22A9P	290	418	1024 x 768	Dual Ethernet	N/A	PanelView Plus 7
1000e	2711E-K10C6	282	(16.64)	640 x 480	Remote I/O	Z/TIP-DIDCZZA9P	(11.42)	(16.46)	1024 X 700	ports	N/A	Performance 15 in.
10006	2711E-T10C15	(11.11)	370	040 X 400	ControlNet		Nos	ocondary o	ption available.			terminal benefits: Higher resolution
	2711E-T10C6		(14.58)		Remote I/O		INO 2	econdary o	puon avanabie.			• DLR Communication =
1200e	2711E-K12C6	355 (13.97)	483 (19.0)	800 x 600	Remote I/O	2711P-B15C22A9P	290 (11.42)	418 (16.46)	1024 x 768	Dual Ethernet ports	N/A	Ethernet.  Operator input = Keypad and touch.  Power input = AC.
	2711E-T12C4	342 (13.50)	351 (13.8)		RS-232		No s	econdary o	ption available.			Conformal coat = No.
	2711E-K14C15		483		ControlNet							PanelView Plus 7 Standard 15 in. terminal benefits:
	2711E-K14C6		(19.0)		Remote I/0							Higher resolution
	2711E-T14C15				ControlNet							Application limits:  • Max. screen count: 100
1400e	2711E-T14C6	355 (13.97)	442 (17.38)	800 x 600	Remote I/O	2711P-T15C21D8S	290 (11.42)	353 (13.90)	1024 x 768	One Ethernet port	N/A	Max. alarm messages:     500     Max. number of     controllers: 1 Communication = Ethernet (dual Ethernet     ports are available). Operator input = only     touch. Power input = only DC. Conformal coat = No.

#### **Accessories**

Some accessories and accessory catalog numbers are new or have changed for PanelView Plus 7 Standard and PanelView Plus 7 Performance terminals. See the accessories section in the respective user manuals that are listed in <a href="Additional Resources on page 10">Additional Resources on page 10</a> for a list of accessories and catalog numbers for the terminals.

### **Legacy Communication Support**

PanelView Plus 7 terminals use only Ethernet communication. If you need support for non-Ethernet communication protocols, go to the following Encompass™ Partner websites:

- http://www.anybus.com/products/prodindex.shtml
- <a href="http://www.prosoft-technology.com/Products/Gateways">http://www.prosoft-technology.com/Products/Gateways</a>

#### **Adapter Kit Conversion Table**

The adapter kit provides hardware for installing a PanelView Plus 7 Performance terminal into the cutout of the existing PanelView terminal. See the Adapter Kit for PanelView 5500 and PanelView Plus 7 Performance Terminals, publication <a href="VIEW-IN0002">VIEW-IN0002</a>.

#### **IMPORTANT**

These adapter kits are for PanelView Plus 7 Performance terminals.

Do not install a PanelView Plus 7 Standard terminal with these adapter kits. The bezel of the standard terminal can be damaged, which can reduce the effectiveness of the seal and damage the terminal and components that are installed in the cabinet.

Adapter Kit Cat. No.	Replace this Existing PanelView Standard or PanelView Enhanced Terminal	With this PanelView Plus 7 Performance Terminal
2711P-RAAT7	N/A	6.5 in. touch screen
2711P-RAAK7	600 terminal, keypad, or keypad with touch screen	6.5 in. keypad with touch screen
2711P-RAAT10	900 terminal, touch screen	10.4 in. touch screen
2711P-RAAK10	900 terminal, keypad	10.4 in. keypad with touch screen
2711P-RAAT12	1000 and 1000e terminals, touch screen	12.1 in. touch screen
2711P-RAAT12K	1000 and 1000e terminals, keypad	12.1 in. touch screen
2711P-RAAT15	1400 and 1400e terminals, touch screen	15 in. touch screen
2711P-RAAK15	1400 and 1400e terminals, keypad	15 in. keypad with touch screen

## **Function Key Comparisons**

**Table 2 - PanelView Plus Replacement Terminals** 

PanelView Standard Terminal	PanelView Plus 7 Replacement Terminal	Adapter Kit Required	Adapter Kit Cat. No.
PanelView Standard 300 or 300 Micro	None <sup>(1)</sup>	_	_
PanelView 550 or 600 touch	PanelView Plus 400 keypad or keypad/touch PanelView Plus 600 touch	No	_
PanelView 550 keypad	PanelView Plus 600 keypad or keypad/touch	No	_
PanelView 550 keypad/ touch	PanelView Plus 400 keypad or keypad/touch PanelView Plus 600 touch	Yes	2711P-RAK4
PanelView 600 keypad	PanelView Plus 600 keypad or keypad/touch	Yes	2711P-RAK6
PanelView 600 keypad/ touch	PanelView Plus 700 keypad or keypad/touch	No	_
PanelView 900 keypad	PanelView Plus 700 keypad or keypad/touch	Yes	2711P-RAK7
	PanelView Plus 1000 keypad or keypad/touch	No	_
PanelView 900 touch	PanelView Plus 700 touch	Yes	2711P-RAT7
	PanelView Plus 1000 touch	No	_
PanelView 1000 keypad	PanelView Plus 1000 keypad or keypad/touch	Yes	2711P-RAK10
	PanelView Plus 1250 keypad or keypad/touch	No	_
PanelView 1000 touch	PanelView Plus 1000 touch	Yes	2711P-RAT10
	PanelView Plus 1250 touch	No	_
PanelView 1400 keypad	PanelView Plus 1250 keypad or keypad/touch	Yes	2711P-RAK12S
	PanelView Plus 1500 keypad or keypad/touch	No	_
PanelView 1400 touch	PanelView Plus 1250 touch	Yes	2711P-RAT12S
	PanelView Plus 1500 touch	No	_

<sup>(1)</sup> You can replace the PanelView Standard 300 or 300 Micro with a PanelView Plus 400 keypad terminal by increasing the size of the current panel cutout.

The table provides a comparison of function keys between the PanelView Standard and PanelView Plus 7 terminals.

**Table 3 - Function Key Comparisons Between Terminal Platforms** 

PanelView Standard Keypad or Keypad/Touch	PanelView Standard Function Keys	PanelView Plus 7 Function Keys	PanelView Plus 7 Terminal Keypad or Keypad/Touch
300M keypad	F1F4		
300 keypad	F1F8	F1F8	400 keypad or keypad/touch
550 keypad or keypad/touch	F1F10	F1F10	600 keypad or keypad/touch
600 keypad or keypad/touch	F1F10	F1F10, K1K12	700 keypad or keypad/touch
900 keypad	F1F16	F1F16, K1K16	1000 keypad or keypad/touch
1000 keypad	F1F16	F1F20, K1K20	1250 keypad or keypad/touch
1400 keypad	F1F16, F17F21	F1F20, K1K20	1500 keypad

## Installing a PanelView Plus 7 Terminal

Optionally install the selected PanelView Plus 7 terminal into the existing PanelView Standard panel cutout. You may need an adapter kit depending on your terminal selection.

**TIP** You can install the terminal after converting and testing your application.

Refer to <u>Additional Resources on page 10</u> for a list of applicable documentation for your terminal replacement and adapter kit, if necessary.

## **Import Your Application**

#### Introduction

In this chapter, you import your existing PanelBuilder\*32 application into FactoryTalk\* View Machine Edition (ME) software.

Different software is used by the PanelView™ Standard and PanelView Plus 7 platforms to develop applications.

- PanelView Standard terminals run applications that are created with PanelBuilder32 software.
- PanelView Plus 7 terminals run applications that are created with FactoryTalk View ME software.

#### **Before You Begin**

- Review the migration considerations (Chapter 1).
- Select a PanelView Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Optionally install the PanelView Plus 7 terminal replacement (Chapter 2). You can install the terminal after migrating and testing your application.

#### **What You Need**


- FactoryTalk View Studio for Machine Edition software with correct version for your PanelView Plus 7 terminal. Refer to <u>Required Software</u> on page 10 for details.
- PanelBuilder32 .pba application file.

The application file can reside on your local hard disk drive or external storage media:

- Secure Digital (SD) card or USB flash drive for PanelView Plus 7 terminals.
- USB flash drive for PanelView Plus 7.

## **Follow These Steps**


Follow these steps to import your PanelBuilder32 application into FactoryTalk View Machine Edition software.




## **Import Application**

Follow these steps to import a PanelBuilder32 application into FactoryTalk View Machine Edition software.

1. Launch the FactoryTalk View Studio software.

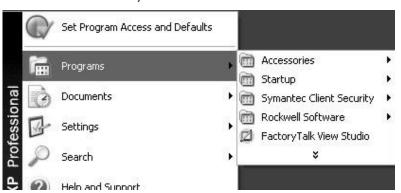

2. Click the New tab.




3. Enter an Application name and click Import.

4. Read the FactoryTalk View dialog box and click OK.

RSLinx® Enterprise software for FactoryTalk View does not need to be installed before you import your PanelBuilder32 application.




5. Select PanelBuilder Application (\*.pba) and click Next.

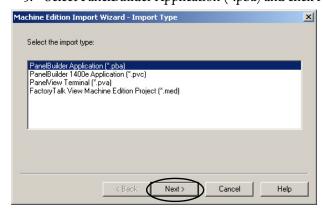

6. Select PanelView Terminal (\*.pva) if you don't have the corresponding .pba file.


7. Click the ... button.

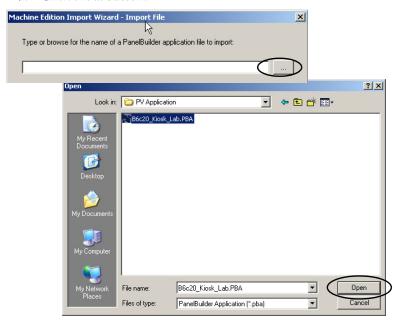

8. Browse to and select your PanelBuilder32 .pba application and click Open.

The .pba or .pva file can reside on your local hard disk drive or external storage appropriate to your terminal.

9. Click Next.

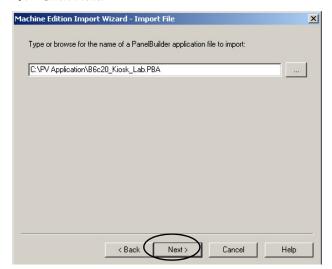


10. Configure the import options that are based on your replacement terminal.

Click Help at any time for clarification of each option.


- a. Check the Convert to new window size checkbox.
- b. Select the size (in pixels) of your PanelView Plus 7 terminal display as shown in the chart.

Panelview Plus 7 Terminal	Resolution (pixels)
PanelView Plus 7 Standard 4 in. (wide)	480 x 272
PanelView Plus 7 Standard 6 in.	640 x 480
PanelView Plus 7 Standard 7 in. PanelView Plus 7 Performance 7 in.	640 x 480
PanelView Plus 7 Standard 9 in. PanelView Plus 7 Performance 9 in. (wide)	800 x 480
PanelView Plus 7 Standard 10 in. PanelView Plus 7 Performance 10 in.	800 x 600
PanelView Plus 7 Standard 12 in. PanelView Plus 7 Performance 12 in. (wide)	1280 x 800
PanelView Plus 7 Standard 15 in. PanelView Plus 7 Performance 15 in.	1024 x 768
PanelView Plus 7 Standard 19 in. PanelView Plus 7 Performance 19 in.	1280 x 1024


- c. Check Scale graphic displays.
- d. When checked, this setting rescales all displays.
- e. If your original PanelView Standard terminal had a touch screen, or both a touch screen and keypad, check the box under Touch property conversion.
- f. Click the Help button to read the differences between the caption alignment options, then select an option for your new application.
- g. Click Finish.

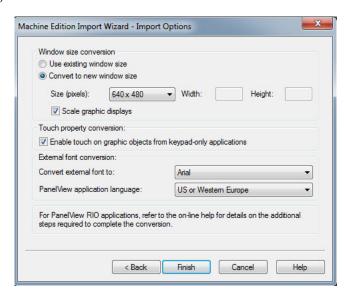

The Importing Project dialog box shows the conversion status. This process may take a while, depending on the size of your application. When done, you will see the Project Status dialog box in the next step.



11. Review the Project Status dialog box and click OK.

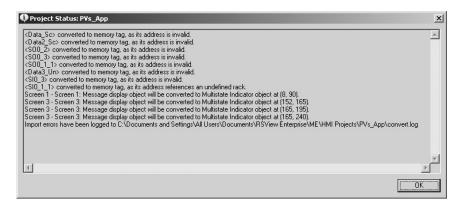

12. Repeat steps 1...11 for each PanelBuilder32 application you want to import into FactoryTalk View ME software.

## **Post Conversion Tips**

This table lists topics to consider after importing an application.

**Table 4 - Post Conversion Tips** 

Software Feature	Description	What You Need To Do
Logout button	A Logout button that is assigned to a function key in a PanelBuilder32 project that does not convert properly in the Machine Edition application.	Reassign the function key manually.
Device shortcuts	After importing a PanelBuilder32 .pba project, you may not see the newly created device shortcuts in the Tag Browser.	Restart FactoryTalk View Studio software. When you reopen the imported application, the shortcuts display correctly.
Screens	When you import PanelBuilder32 projects, all screens are minimized.	Nothing
Multistate objects	The first state value of PanelBuilder32 multistate objects is 1. In Machine Edition software, the first state value of multistate objects is 0.	If the imported application contains any of these multistate objects, verify the state values:  Control list selector List indicator Multistate indicator Latched push button Maintained push button Momentary push button Multistate push button Symbol indicator

## **Review the Application Conversion Log**

#### Introduction

In this chapter, you review the conversion log generated by FactoryTalk\* View Machine Edition (ME) software for your imported application. The results of this log help you to determine what updates are required in your converted application.

## **Before You Begin**


- Review migration considerations (Chapter 1).
- Select a PanelView™ Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Install the PanelView Plus 7 terminal in the existing PanelView Standard panel cutout (Chapter 2).
- Import your PanelBuilder\*32 .pba application into FactoryTalk View ME software (Chapter 3).

#### **What You Need**

- The new name of the application that was imported into FactoryTalk View ME software. This action was completed in Chapter 3.
- Conversion log, convert.log, generated by the FactoryTalk View ME import wizard.

## **Follow These Steps**

Follow this path to review changes that are required to your FactoryTalk View ME application.



#### **About the Conversion Log**

The application conversion log, convert.log, is generated by the import wizard when you import your PanelBuilder32 application into FactoryTalk View ME software. This log provides detailed information about objects or features that did not convert directly from your PanelBuilder32 application. Use this log as a guide to update your application accordingly. Modifications to the application are required to verify that the application operates correctly in FactoryTalk View ME software.

#### **IMPORTANT**

It is important that you review each object and feature in the converted application to verify that they function as expected. Because PanelBuilder32 objects or features may not map directly into FactoryTalk View ME software, you may need to update your ladder logic to achieve the same operational results.

## **Open the Conversion Log**

The conversion log, convert.log, is stored with the new application that was imported into FactoryTalk View ME software.

Follow these steps to locate the conversion log on your computer.


1. Navigate to this folder.

C:\Documents and Settings\All Users\Documents\RSView Enterprise\ME\HMI projects\

**TIP** All of your FactoryTalk View ME applications are located in this folder. This includes new or imported applications.

2. Double-click the HMI project folder that contains the new application name you created.

You entered this name in the import wizard when importing your PanelBuilder32 application into FactoryTalk View ME software.

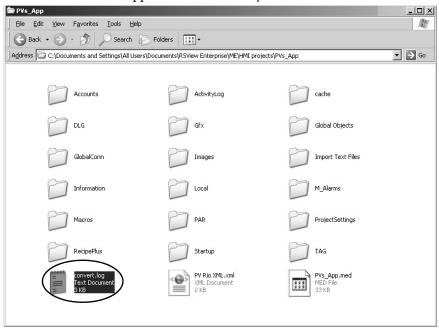

3. Double-click the convert.log file that is generated by the import wizard.

Your convert.log file varies from the example shown.

```
| Converted Get Forms Yew Help
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory tag, as its address is invalid.
| Coata_Sc> Converted to memory
```

## **Review the Conversion Log**

The conversion log file, convert.log, contains a list of messages including warnings, errors, and unsupported features or objects in the converted application. You can compare these messages to the messages in the tables for information on why the message was logged. For your convenience, the message tables are categorized into these groups:

- RSLinx® software
- Tags
- Objects and screens
- Alarms

When resolving conversion log messages, refer to your original PanelBuilder32 application to review how the objects and tags were used.

During conversion, all PanelBuilder32 tag names and addresses are converted to HMI tags in the FactoryTalk View ME tag database.

IMPORTANT	Some features or objects are no longer supported in FactoryTalk View ME
	software. However, new features or objects are available providing the
	same or enhanced functionality.

#### **Conversion Messages You Can Ignore**

Some error messages appear consistently when importing PanelBuilder32 projects and can be ignored.

Table 5 - Conversion Messages: T o Be Ignored

Error Type	Ignore this Error
Startup editor	The initial screen does not exist in the graphics list.
Startup editor	Failed to get startup information.
Format error	File c:\documents and settings\all users\documents\rsview enterprise\me\hmi project\app1\import text files\almsg.txt, section/key 'main'
Tags	Tags with a bit data type and a scale value of 0 are incorrectly logged during the import.
Scale errors	Tag scale errors are logged only for analog tags.

## **RSLinx Messages**

This table lists RSLinx messages that may appear in the convert.log file.

Table 6 - Conversion Log Messages: RSLinx Software

Message	Description
RSLinx Topic Converter log file that is created on <date> at <time>. RSLinx2X topics to RSLinx Enterprise shortcuts conversion failed. You must manually convert topics to shortcuts.</time></date>	Review the HMI tags in FactoryTalk View ME software and note the shortcut name. It is the same as the controller name in the PanelBuilder32 application. You must use this name when creating the shortcut in FactoryTalk View ME software.  For information on creating shortcuts, refer to:  FactoryTalk View Machine Edition User Guide, Volume 1, publication ViewME-UM004, for details on creating shortcuts.  Videos at http://www.rockwellautomation.com/solutions/integratedarchitecture/resources4.html
RSLinx is not installed. Install the latest RSLinx software for proper import. Cannot create instance of RSLinx. Topic generation does not succeed.	In FactoryTalk View ME software, configure communication and create a shortcut.

#### **Screen and Object Conversion Messages**

Table 19 lists screen and object messages that may appear in the convert.log file. Most of the messages identify these attributes for a FactoryTalk View ME object:

- Screen number and name
- Location (x,y) of the object
- New graphic object name

Use this information to locate the object and make required modifications. The description for a message may reference a workaround in this document.

Here are some general notes on object conversions:

- Numeric display objects in PanelBuilder32 software are converted to Text objects with embedded variables in FactoryTalk View ME software.
- A Numeric Input Enable button in FactoryTalk View ME software does not have a separate display tag. The display value is converted to an embedded variable on the Label Tab.
- The Numeric Input Cursor object in FactoryTalk View ME software has a separate indicator tag and does not have a Label tab for text.

Table 7 - Conversion Log Messages: Screens and Objects

Message	Description	
Message display object is converted to Multistate Indicator object at <location>.</location>	A message display in PanelBuilder32 software is the same as a multistate indicator in FactoryTalk View ME software.	
Verify password button at <location> not supported.</location>	The Verify Password button is not supported in FactoryTalk View ME software.	
Select Operator button at <location> not supported.</location>	The Select Operator button is not supported in FactoryTalk View ME software.	
Screen security settings not converted.	Security settings are not converted in FactoryTalk View ME software. You must reconfigure all security settings.	
String popup is invoked with blank scratchpad on <location>.</location>	Verify operation in FactoryTalk View ME software.	
Cannot find block write start tag for pilot list selector at <location>. The visible state connection is unassigned.</location>	The Piloted Control List Selector in PanelBuilder32 software does not have a block write tag assigned. Assign a block write tag in FactoryTalk View ME software if you want a visible state connection.	
For LSB support, refer to online help for correct syntax of Multistate Indicator's Value control at < location > .	FactoryTalk View ME software does support Least Significant Bit (LSB) on multistate and list indicators. Check the object and make sure that the syntax is correct for the value.  The L parameter is used only for message addresses that are more than one word in length. See the FactoryTalk View online help for information on the L parameter.	
Blinking color images are not supported.	FactoryTalk View ME software does not support blinking color images.	
Print Only objects not supported.	FactoryTalk View ME software does not support Print Only objects.	
Line at <location> could not have property set: Width.</location>	In FactoryTalk View ME software, lines have a line width that is separate from the object location.	
Line at <location> could not have property set: Height.</location>	In FactoryTalk View ME software, lines have a line height that is separate from the object location.	
Numeric entry enable button at <location> could not have property set: Minimum Value.  Numeric entry enable button at <location> could not have property set: Maximum Value.</location></location>	The Numeric Entry Enable button is converted to a Numeric Input Enable button in FactoryTalk View ME software.  In PanelBuilder32 software, the input and display floating point tags shared name and address. The min/max values were out of range and could not be set in the FactoryTalk View ME object.  In FactoryTalk View ME software, set the default min and max for floating point. The display value is an embedded variable on the Label tab.	

#### **Tag Conversion Messages**

This table lists tag messages that may appear in the convert.log file.

**Table 8 - Conversion Log Messages: Tags** 

Message	Description
Invalid characters not supported. Tag has been converted to <name>.</name>	FactoryTalk View ME software does not support periods in tag names. The periods are converted to underscores.
Already exists in the tag database.	The converted tag already exists in the FactoryTalk View ME HMI tag database or the conversion created it.
Could not be added to the tag database.	Verify that all tag names exist in the FactoryTalk View HMI tag database after the conversion.
The minimum value for this tag was invalid and has been set to the minimum value based on the tag's data type.	The minimum value for the tag in the PanelBuilder32 application is not valid in the FactoryTalk View ME application. This discrepancy was corrected. The minimum value for the tag was set according to the tag's data type. Verify that the tag data type and minimum value are correct.
The maximum value for this tag was invalid and has been set to the minimum valid value based on the tag's data type.	The maximum value for the tag in the PanelBuilder32 application is not valid in the FactoryTalk View ME application. This discrepancy was corrected. The maximum value for the tag was set according to the tag's data type. Verify that the tag data type and maximum value are correct.
The scale for this tag was invalid and has been set to its default value.	Verify that the scale for the tag data type is correct.
Tag converted to memory tag, as its addressing syntax is not supported.	For this specific instance, an RIO bit array data type with a length of 2 is using output 0:xxx address.  In the converted application. FactoryTalk View ME software does not support bit arrays. Bit arrays are converted to memory tags.
Tag converted to memory tag, as its address is blank.	The tag was converted to a memory tag because the tag address was blank in the PanelBuilder32 software.
The array size for this tag was invalid and has been set to the maximum supported size.	The character array size was converted to the maximum string length of 82 in the FactoryTalk View ME application.
Bit array tags are not supported. Tag will be converted as a memory tag.	FactoryTalk View ME software does not support the bit array data type. Typically, bit arrays were used in PanelBuilder32 software for addresses less than one word in length.  In FactoryTalk View ME software, change the tag address to a full word address. When you use non-Remote I/O addresses, these conversions take place:  Bit array is converted to an analog, default type Device tag with a word length as opposed to a memory tag.  BOOL is converted to a bit tag.  DINT is converted to an analog, long integer tag.

## **Alarm Conversion Messages**

This table lists alarm messages that may appear in the convert.log file.

For optimal performance, convert PanelBuilder32 alarm tags to direct reference tags in FactoryTalk View ME software. Use the L parameter for the length in 16-bit words. The alarm trigger type can be bit.

See the FactoryTalk View online help for information on the word length L parameter.

**Table 9 - Conversion Log Messages: Alarms** 

Message	Description
Bit and LSBit triggered alarms that used a trigger tag with a bit data type will only be able to trigger a single alarm after import.	See <u>Alarm Trigger Tags</u> on <u>page 12</u> for details on alarm tag data types.
Alarm message Ack option not supported.	In PanelBuilder32 software, the alarm ACK is on an individual message. FactoryTalk View ME software does not support individual acknowledgement of alarms. The alarm Ack is on the triggers.
Alarm List at <location> displays all alarms.</location>	This message describes the type of alarm list.
Alarm List at < location > displays all active alarms.	This message describes the type of alarm list.
Alarm List at <location> will display all alarms that have come out of alarm.</location>	This message describes the type of alarm list.
Alarm List at <location> does not support displaying alarms that do not require acknowledgement.</location>	This message describes the type of alarm list.
"Remote Clear All Alarm Tag" alarm control not supported.	FactoryTalk View ME software does not support this alarm tag.
"Remote Clear All Alarm Handshake Tag" alarm control not supported.	FactoryTalk View ME software does not support this alarm tag.
Tag converted to memory tag, as its address is blank.	The tag was converted to a memory tag because the tag address was blank in PanelBuilder32 software.
The array size for this tag was invalid and has been set to the maximum supported size.	The character array size was converted to the maximum string length of 82.
Bit array tags are not supported. Tag will be converted as a memory tag.	FactoryTalk View ME software does not support the bit array data type. Typically, bit arrays were used in PanelBuilder32 software for addresses less than one word in length.  In FactoryTalk View ME software, change the tag address to a full word address. When using non-Remote I/O addresses, these conversions take place:  Bit array is converted to an analog, default type device tag with a word length as opposed to a memory tag.  BOOL is converted to a bit tag.  DINT is converted to an analog, long integer tag.

## **Review Object Mapping**

#### Introduction

In this chapter, you review how objects and alarms from PanelBuilder\*32 software map to FactoryTalk\* View Machine Edition (ME) software.

## **Before You Begin**


- Review migration considerations (Chapter 1).
- Select a PanelView<sup>™</sup> Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Optionally install the PanelView Plus 7 terminal in the existing PanelView Standard panel cutout (Chapter 2).
- Import your PanelBuilder32 .pba application into FactoryTalk View ME software (Chapter 3).
- Review the conversion log for your imported application (Chapter 4).

#### **What You Need**

Conversion log generated by the FactoryTalk View ME Import Wizard for the imported application.

## **Follow These Steps**

Follow these steps to review how PanelBuilder32 objects and alarms map to FactoryTalk View ME software. This information helps you correct application errors that are listed in the conversion log.



## **Reviewing Object Mapping**

This table identifies how some PanelBuilder32 graphic objects migrate into a FactoryTalk View ME application.

#### **IMPORTANT**

It is important that you verify the function of all objects after importing your application to FactoryTalk View ME software. New objects may not function as expected.

#### Table 10 - Object Mapping

This PanelBuilder32 object	Maps to this FactoryTalk View ME object
Message Display	Multistate Indicator
Numeric Entry Cursor Point	Numeric Input Enable
Increment/Decrement Entry	Numeric Input Enable
ASCII Entry Cursor Point	String Input Enable
Numeric Display	Text object with numeric embedded variable
Connected Line	Polyline
Circle	Ellipse
Freeform	Freehand
Bar Graph and Gauge Inner Text	Bar Graph with separate Text object
Bar Graph and Gauge Inner Graphic	Bar Graph with separate Image object
Gauge Needle	Separate Gauge object. For example, in PanelBuilder32 software, a Gauge object is configured with two needles. This object is converted to two separate Gauge objects in Machine Edition software.

## Reviewing Data Type Mapping

This table shows how data types map between PanelBuilder32 and Machine Edition software.

Table 11 - Data Type Mapping

PanelBuilder32 Data Types	Machine Edition Data Types
Bit	Digital
Bool	Digital
Char array	String (82 character max)
Unsigned integer	Unsigned
Signed integer	Int
IEEE	Floating Point (FP)
4BCD	4BCD
none	3BCD
none	Byte (unsigned 0255)
Bit array	None
DINT	Long Int (signed 32 bit)
SINT (8 bit signed)	None

# Reviewing Mapping of Communication Networks

This table shows communication protocols that are supported by PanelBuilder32 and FactoryTalk View ME applications.

**Table 12 - Mapping of Communication Networks** 

PanelBuilder32 Communication Protocols	FactoryTalk View ME Communication Protocols
RS-232 (DF1)	RS-232 (DF1)
RS-232 (DH-485)	RS-232 (DH-485)
DH-485	DH-485
DH+™	DH+ Does not support nodes that use the AutoMax® node type
EtherNet/IP  - EtherNet/IP controller address  - EtherNet/IP CIP  - Assembly object	EtherNet/IP  — Supported  — Not supported  — Not supported
RIO	RIO <sup>(1)</sup>
DeviceNet	Not supported <sup>(1)</sup>
ControlNet	ControlNet
	KEPWare communication drivers for third- party controllers

<sup>(1)</sup> Remote I/O and DeviceNet communication modules are not available for PanelView Plus 6 terminals.

Notes:

## **Review Unsupported Features**

#### Introduction

In this chapter, you review unsupported features in FactoryTalk® View Machine Edition (ME) software. This review helps you resolve errors in the imported application.

## **Before You Begin**


- Review migration considerations (Chapter 1).
- Select a PanelView<sup>™</sup> Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Optionally install the PanelView Plus 7 terminal in the existing PanelView Standard panel cutout (Chapter 2).
- Import your PanelBuilder32 .pba application into FactoryTalk View ME software (Chapter 3).
- Review the conversion log for your migrated application (Chapter 4).
- Review object mapping (Chapter 5).

#### **What You Need**

Conversion log generated by the FactoryTalk View ME import wizard for the imported application.

## **Follow These Steps**

Follow this path to review unsupported features in FactoryTalk View ME software.



# Reviewing Unsupported Objects

These PanelBuilder\*32 objects are not supported in FactoryTalk View ME software:

- Print Only
- Circular Scale
- Scrolling Text
- Print Alarm Button
- Horn Silence Button and Lamp/Horn Test Button
- Select Operator Button
- Enable/Disable Security Button
- New Password Button
- Verify Password Button

## Reviewing Unsupported Tags and Controls

These PanelBuilder32 controls are not supported in Factory Talk View ME software:

- Remote Ack All Handshake tag
- Remote Clear All Alarm tag
- Remote Clear All Alarm Handshake tag
- Message to Remote Device Notification tag
- Message to Remote Device Handshake tag
- Ack setting for alarms
- Bit alarm acknowledgement
- Handshaking for alarms that are sent to a remote device

## Reviewing Unsupported Features

Some PanelBuilder32 features are not supported in FactoryTalk View Machine Edition software. Compare the conversion log with the information on unsupported features to assist with updates to your imported application. Additional information is provided where possible to achieve the same functionality by using another option or workaround in your imported application.

Table 13 - Unsupported Features in FactoryTalk View Machine Edition

Unsupported Feature	<b>Object</b>	Additional Information
Blink	Text Arc Ellipse Line Panel Rectangle Wedge	In FactoryTalk View ME software, all list objects use color animation to blink.
	Image	Color images do not blink. Monochrome images use the Blink property to enable blinking.
Allow Home/End Allow Wrap Ramping by Coarse Steps	Increment/Decrement Entry Button (Converted to Numeric Input Enable Button)	The Increment/Decrement Entry button is converted to a Numeric Input Enable button in FactoryTalk View ME software.

Table 13 - Unsupported Features in FactoryTalk View Machine Edition

Unsupported Feature	Object	Additional Information
Print Setting	Multistate Indicator Message Display	
Printing	Print Only Object	This object is not supported in FactoryTalk View ME software.
Initial State Values	Maintained Push button Multistate Push button Standard Control List Selector	To set the states of these objects on application startup, create a macro to set the appropriate tag values for the object controls. Assign the Macro in the Startup editor of FactoryTalk View ME software.
Least Significant Bit data format	Multistate Indicator Message Display List Indicator Standard Control List Selector	Bit triggered states are not supported in FactoryTalk View ME software. Modify the state values and the read tag, or assign an expression to return the value of the Least Significant Bit.
Inner Text and Inner Graphic	Bar Graph Gauge	In FactoryTalk View ME software, the Inner Text is converted to a separate Text object. The Inner Graphic is converted to a separate Image object.
Scale Clipping	Gauge	If the scale doesn't fit within the height or width of the gauge, it is not clipped. Check the position of the scale to make sure it doesn't overlap other objects.
Needle	Gauge	In FactoryTalk View ME software, each needle is converted to a separate Gauge object.
No Acknowledgement	Alarm List	In FactoryTalk View ME software, all alarms can be acknowledged.
Ack Setting	Alarm messages	In FactoryTalk View ME software, all alarms can be acknowledged.
Turn Object View On property	All objects	If this property is set to False, the converted object does not appear.
Embedded Variable	Numeric Display	Numeric Display objects are converted to Text objects with embedded variables.
Foreground and background colors	All objects	The foreground and background colors of PanelBuilder32 objects are used to set the Selection Fore and Selection Back color for FactoryTalk View ME objects.
		If the foreground and background colors are the same, the Selection Fore and Back colors are also the same. This color status means that the selected state is invisible, because the foreground color (text) and the background color are the same.  To make the selected state visible, edit the object to change either the Selection Fore or Selection Back color.
Selected state visibility during design time and runtime	List Indicator Display List Selector Control List Selector Piloted Control List Selector Alarm List Selector	If the original Foreground Color (text) and Background Color of the object are the same, the selected state is invisible. To make the selected state visible, edit the object to change either the Selection Fore or Selection Back color.

Table 13 - Unsupported Features in FactoryTalk View Machine Edition

Unsupported Feature	Object	Additional Information
Caption and image placement	All objects	FactoryTalk View ME software supports one, three, or nine positions for captions and images, depending on the type of object. On conversion, captions and images are positioned using the closest match. Some captions might do the following:  Overlap images Get truncated Get clipped to fit the object Realign or resize objects for best fit.
Goto Configure Mode Button	Object not converted	
Security	Enable/Disable Security Button New Password Button Verify Password Button	In the PanelBuilder32 software, user passwords are create in the Configuration mode screens. FactoryTalk View ME software requires the Change Password button on a display.
	Security Settings	FactoryTalk View ME software uses a different method to assign security to graphic displays.  You must reconfigure security. Once logged on, the operator does not need to reenter the password until manually logged off, or optionally after an idle time.

## **Qualify the Runtime Application**

#### Introduction

In this chapter, you qualify the integrity of your converted application before downloading and running it in your production environment. Because you are using different software with new features and functionality, it is important to validate the application for proper operation.

## **Before You Begin**


- Review migration considerations (Chapter 1).
- Select a PanelView™ Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Optionally install the PanelView Plus 7 terminal in the existing PanelView Standard panel cutout (Chapter 2).
- Import your PanelBuilder32 .pba application into FactoryTalk\* View ME software (Chapter 3).
- Review the conversion log for your migrated application (Chapter 4).
- Review object mapping (Chapter 5).
- Review unsupported features (Chapter 6).

#### **What You Need**

Converted FactoryTalk ME application.

## **Follow These Steps**

Follow these steps to configure diagnostics, validate, test run, configure global memory connections, download, and run your converted application on a PanelView Plus 7 terminal.

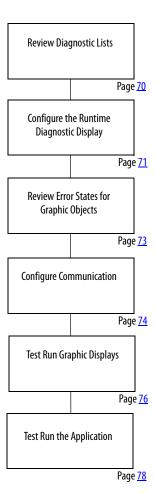

## **Review Diagnostic Lists**

On your development computer, FactoryTalk View ME software features a diagnostic list at the bottom of the application window. You can configure FactoryTalk diagnostics to display information, warnings, and errors during application development and runtime.

When you test run your application, the diagnostic list displays messages and errors that are logged by the application. Use this list to identify the graphic objects or features that generated the messages or errors. Correct these errors during the validation process.

The diagnostic lists let you clear one or all messages in the list:

- Click the Clear button to delete the message that is displayed.
   If you resize the list to display multiple messages, select a message and then click Clear.
- Click the Clear All button to delete all messages in the list.




To view this diagnostic information during runtime, use either of the following:

- Default [DIAGNOSTICS] graphic display
- Diagnostic list object in a customized graphic display
  - TIP The [DIAGNOSTICS] display is in the Libraries editor of the application Explorer window if not already included in your application displays. Import the [DIAGNOSTIC] display if you are going to use it.

# Configure the Runtime Diagnostic Display

Follows these steps to configure the default [DIAGNOSTICS] display to log errors or warnings that are generated during runtime operation.

- 1. Launch FactoryTalk View ME software if not open.
- 2. Open your converted application.
- 3. Expand the System folder in your application Explorer window.
- 4. Double-click Diagnostic List Setup.



5. Under Runtime display, verify that [DIAGNOSITICS] is the Display name.

This display is the default diagnostic display that pops up during runtime when configured events occur.

6. Check the boxes next to the messages that you want to appear in the display when events occur during runtime.

It is recommended that you always log errors and warnings during runtime.

For information on how each dialog option is designed to function during runtime, click Help.

7. Click OK.



# Review Error States for Graphic Objects

In FactoryTalk View ME software, error conditions for visible objects may be different than the error conditions in PanelBuilder\*32 software. The table clarifies what happens when errors occur for objects when tags are unavailable or communication is lost.

For additional information on objects, refer to the FactoryTalk View Machine Edition online help.

**Table 14 - Error Modes for Objects** 


<ul> <li>Momentary Push Button</li> <li>Maintained Push Button</li> <li>Latched Push Button</li> <li>Multistate Push Button</li> <li>Ramp Push Button</li> <li>Ramp Push Button</li> <li>No visible error message or error condition is displayed. When you click these objects, an error message is generated and logged to the diagnostic list object.</li> <li>Numeric Display</li> <li>Numeric Input Cursor</li> <li>Numeric Input Enable</li> <li>String Input Enable</li> <li>How Sistile error message or error condition is displayed.</li> <li>If communication to the PLC controller is lost, these buttons still let you navigate through your application.</li> <li>If communication to the PLC controller is lost, these buttons still let you navigate through your application.<th>Graphic Object</th><th colspan="3">Visible Error Mode</th></li></ul>	Graphic Object	Visible Error Mode		
Ramp Push Button  Numeric Display Numeric Input Cursor  Numeric Input Enable String Input Enable String Display Goto Display Button Return To Display Button Return To Display Button Close Display List Selector Close Display Button Close Display Button Multistate Indicator  The caption displays Error for the error state.  Symbol Properties The object shows the image color that is defined in the error state.  List Indicator No visible error message or error condition is displayed. This object shows a transparent wireframe box.  Scale No visible error message or error condition is displayed.  Local Message Display This object displays question marks, ???????, in the error state.  No visible error message or error condition is displayed.  Backspace Enter Home Move Left Move Right Mowe Down Page Up Page Down  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  This object appears not to have any pens and does not perform real time trending.	<ul><li>Maintained Push Button</li><li>Latched Push Button</li></ul>			
<ul> <li>Numeric Input Cursor</li> <li>Numeric Input Enable</li> <li>String Input Enable</li> <li>String Display</li> <li>Goto Display Button</li> <li>Display List Selector</li> <li>Close Display Button</li> <li>Button Jisplay Button</li> <li>Display List Selector</li> <li>Close Display Button</li> <li>Multistate Indicator</li> <li>The caption displays Error for the error state.</li> <li>Symbol Properties</li> <li>The object shows the image color that is defined in the error state.</li> <li>List Indicator</li> <li>No visible error message or error condition is displayed.</li> <li>Bar Graph Gauge</li> <li>This object shows a transparent wireframe box.</li> <li>Scale</li> <li>No visible error message or error condition is displayed.</li> <li>Local Message Display</li> <li>This object displays question marks, ???????, in the error state.</li> <li>Backspace</li> <li>End</li> <li>End</li> <li>Home</li> <li>Move Left</li> <li>Move Down</li> <li>Page Down</li> <li>Sort Alarm</li> <li>Alarm Banner</li> <li>Alarm Status List</li> <li>Display Print</li> <li>No visible error message or error condition is displayed.</li> <li>This object appears not to have any pens and does not perform real time trending.</li> </ul>		When you click these objects, an error message is		
<ul> <li>String Input Enable         <ul> <li>String Display</li> <li>Goto Display Button</li> <li>Return To Display Button</li> <li>Return To Display Button</li> <li>Display Button</li> <li>Return To Display Button</li> <li>Display List Selector</li> <li>Close Display Button</li> <li>Display List Selector</li> <li>Close Display Button</li> </ul> </li> <li>Multistate Indicator</li> <li>The caption displays Error for the error state.</li> <li>Symbol Properties</li> <li>The object shows the image color that is defined in the error state.</li> <li>Ist Indicator</li> <li>No visible error message or error condition is displayed.</li> <li>Bar Graph Gauge</li> <li>This object shows a transparent wireframe box.</li> <li>Scale</li> <li>No visible error message or error condition is displayed.</li> <li>Local Message Display</li> <li>This object displays question marks, ????????, in the error state.</li> <li>Backspace</li> <li>Enter</li> <li>Home</li> <li>Move Left</li> <li>Move Right</li> <li>Move Down</li> <li>Page Up</li> <li>Page Up</li> <li>Page Up</li> <li>Page Up</li> <li>Alarm Banner</li> <li>Alarm Status List</li> <li>Display Print</li> <li>No visible error message or error condition is displayed.</li> <li>This object appears not to have any pens and does not perform real time trending.</li> </ul>		These objects display asterisks, ******.		
<ul> <li>Return To Display Button</li> <li>Display List Selector</li> <li>Close Display Button</li> <li>Multistate Indicator</li> <li>The caption displays Error for the error state.</li> <li>Symbol Properties</li> <li>The object shows the image color that is defined in the error state.</li> <li>List Indicator</li> <li>No visible error message or error condition is displayed.</li> <li>Bar Graph Gauge</li> <li>This object shows a transparent wireframe box.</li> <li>Scale</li> <li>No visible error message or error condition is displayed.</li> <li>Local Message Display</li> <li>This object displays question marks, ???????, in the error state.</li> <li>No visible error message or error condition is displayed.</li> <li>End</li> <li>Enter</li> <li>Home</li> <li>Move Left</li> <li>Move Bight</li> <li>Move Down</li> <li>Page Up</li> <li>Page Down</li> <li>Sort Alarm</li> <li>Alarm Banner</li> <li>Alarm Status List</li> <li>No visible error message or error condition is displayed.</li> <li>Trend</li> <li>Trend</li> <li>This object appears not to have any pens and does not perform real time trending.</li> </ul>	String Input Enable	When you click these objects, an error message is		
Symbol Properties  The object shows the image color that is defined in the error state.  No visible error message or error condition is displayed.  Bar Graph Gauge  This object shows a transparent wireframe box.  Scale  No visible error message or error condition is displayed.  Local Message Display  This object displays question marks, ???????, in the error state.  No visible error message or error condition is displayed.  End Enter Home Move Left Move Right Move Down Page Up Page Down  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  Trend  No visible error message or error condition is displayed.	<ul><li>Return To Display Button</li><li>Display List Selector</li></ul>	If communication to the PLC controller is lost, these		
List Indicator  Bar Graph Gauge  This object shows a transparent wireframe box.  Scale  No visible error message or error condition is displayed.  Indicator  No visible error message or error condition is displayed.  This object displays question marks, ???????, in the error state.  No visible error message or error condition is displayed.  End End End No visible error message or error condition is displayed.  End Move Left Move Right Move Down Page Up Page Down  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  No visible error message or error condition is displayed.  Trend  No visible error message or error condition is displayed.	Multistate Indicator	The caption displays Error for the error state.		
Bar Graph Gauge This object shows a transparent wireframe box.  Scale No visible error message or error condition is displayed.  Local Message Display This object displays question marks, ??????, in the error state.  No visible error message or error condition is displayed.  End Enter Home Move Left Move Right Move Down Page Up Page Down  Sort Alarm Reset Alarm Alarm Banner Alarm Status List  Display Print No visible error message or error condition is displayed.  Trend This object appears not to have any pens and does not perform real time trending.	Symbol Properties			
Scale  No visible error message or error condition is displayed.  Local Message Display  This object displays question marks, ??????, in the error state.  No visible error message or error condition is displayed.  End Enter Home Move Left Move Right Move Down Page Up Page Down  Sort Alarm Reset Alarm Alarm Banner Alarm Status List  Display Print  No visible error message or error condition is displayed.  Trend  This object appears not to have any pens and does not perform real time trending.	List Indicator	No visible error message or error condition is displayed.		
Local Message Display  This object displays question marks, ???????, in the error state.  No visible error message or error condition is displayed.  Enter Home Move Left Move Right Move Down Page Up Page Down  Sort Alarm Reset Alarm Alarm Banner Alarm Status List  Display Print  No visible error message or error condition is displayed.  Trend  This object appears not to have any pens and does not perform real time trending.	Bar Graph Gauge	This object shows a transparent wireframe box.		
State.  Backspace End Enter Home Move Left Move Right Move Down Page Up Page Down  Sort Alarm Reset Alarm Alarm Banner Alarm Status List  Display Print  No visible error message or error condition is displayed.  Trend  This object appears not to have any pens and does not perform real time trending.	Scale	No visible error message or error condition is displayed.		
<ul> <li>End</li> <li>Enter</li> <li>Home</li> <li>Move Left</li> <li>Move Right</li> <li>Move Down</li> <li>Page Up</li> <li>Page Down</li> <li>Sort Alarm</li> <li>Reset Alarm</li> <li>Alarm Banner</li> <li>Alarm Status List</li> <li>Display Print</li> <li>No visible error message or error condition is displayed.</li> <li>Trend</li> <li>This object appears not to have any pens and does not perform real time trending.</li> </ul>	Local Message Display			
<ul> <li>Reset Alarm</li> <li>Alarm Banner</li> <li>Alarm Status List</li> <li>Display Print</li> <li>No visible error message or error condition is displayed.</li> <li>Trend</li> <li>This object appears not to have any pens and does not perform real time trending.</li> </ul>	<ul> <li>End</li> <li>Enter</li> <li>Home</li> <li>Move Left</li> <li>Move Right</li> <li>Move Down</li> <li>Page Up</li> </ul>	No visible error message or error condition is displayed.		
Trend This object appears not to have any pens and does not perform real time trending.	<ul><li>Reset Alarm</li><li>Alarm Banner</li></ul>	No visible error message or error condition is displayed.		
perform real time trending.	Display Print	No visible error message or error condition is displayed.		
Time and Date No visible error message or error condition is displayed.	Trend	This object appears not to have any pens and does not perform real time trending.		
	Time and Date	No visible error message or error condition is displayed.		

## **Configure Communication**


You are now ready to configure communication for your imported application. Because this application is a new application, a communication configuration does not exist. The configuration varies depending on the communication protocol you use.

Follow these steps to configure communication for your application.

1. In the Explorer window, expand RSLinx® Enterprise and double-click Communication Setup.

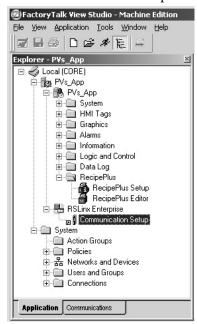


2. Select Create a New Configuration and click Finish.

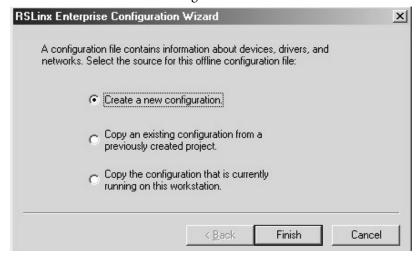

3. In the Communication Setup dialog box, select the Local tab.


This communication path is used for testing individual displays and Test Application.

4. Select the driver that you are using in your design environment to test communication.

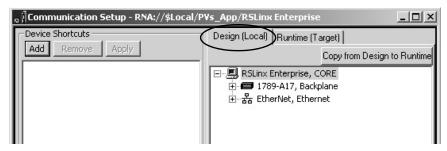


Browse to the controller device and configure local communication.

5. Select the Target tab.



This communication path is used on the PanelView Plus to communicate to the controller in your runtime application in Chapter 8.

- 6. Right-click RSLinx Enterprise and select Add Driver.
- 7. Select the appropriate driver and click OK.



8. Configure the driver properties.

**TIP** Remote I/O and DeviceNet communication modules are not supported by the PanelView Plus 7terminals.

PanelView Plus Compact 400, 600, and 1000 terminals are fixed hardware configurations that do not support communication modules.

For	On This Terminal	+	Communication Module	Select
DH+™	PanelView Plus 6 (7001500) <sup>(1)</sup>	+	2711P-RN6 or 2711P-RN6K	DH+ (1784-PKTX, 2711P-RN6, 2711P-RN8)
	PanelView Plus 400 or 600	+	2711P-RN8	DH+ (1784-PKTX, 2711P-RN6, 2711P-RN8)
DH-485	PanelView Plus 6 (7001500) <sup>(1)</sup>	+	2711P-RN6 or 2711P-RN6K	DH-485 (1784-PKTX, 2711P-RN6)
	PanelView Plus 400 or 600	+	2711P-RN3	Serial DH-485 (including 2711P-RN3, 2711P-RN22C)
ControlNet	PanelView Plus 6 (7001500) <sup>(1)</sup>	+	2711P-RN15S or 2711P-RN15SK	ControlNet (1784-PCIC, 1784-PCICS, 2711P-RN15S) or ControlNet (1784-PKTCS, 2711P-RN15S, 2711P-RN15C)
	PanelView Plus 400 or 600	+	2711P-RN15C	ControlNet (1784-PKTCS, 2711P-RN15S, 2711P-RN15C)

<sup>(1)</sup> Also applies to PanelView Plus 700 to 1500 terminals running FactoryTalk View Machine Edition Firmware Revision 5.1 or earlier.

#### **ControlNet Communication**

See ControlNet Communication for PanelView Plus 7 Terminals user manual, publication, <u>2711P-UM003</u>, for step-by-step details on how to configure ControlNet Scheduled and Unscheduled communication with FactoryTalk View ME software.

## **Test Run Graphic Displays**

FactoryTalk View ME software provides a Test Display mode to test the animation and assigned tags that are connected to objects in a graphic display. Any information, warning, or errors are logged to the diagnostic list for your review.

Test Display mode tests all objects in a display:

- Button objects
- Numeric and string objects to verify that correct values are displayed
- Objects that require user input
- Objects that use animation

# **IMPORTANT** You must be connected to the controller and online before test running the display or all objects show their error states.


For each object tested, review and correct any errors and warnings that are logged to the diagnostic list. Retest the display object before proceeding to the next object.

#### **IMPORTANT**


In Test Display mode, objects in the display are activated and connected to assigned tags. Only tags connected to objects in the display work. Links to other displays or alarms, including data logging, macros, global connections, and information messages do not work.

Follow these steps to activate Test Display mode for a display and then return to Edit mode. Running Test Display mode and correcting logged errors in Edit mode is an iterative process.


- 1. Open the display that you want to test.
- 2. Access Test Display mode in one of two ways.
  - Choose Test Display from the View menu.




• Click the Test Display button on the toolbar.



- 3. Return to Edit mode in one of two ways.
  - Choose Edit Display from the View menu.



• Click the Edit Display button on the toolbar.



## **Test Run the Application**


After testing and verifying that each graphic display is error free, you are ready to test run the entire application. Application Test mode lets you navigate through the entire application to validate functions that are not tested in Display Test mode. Some of these features include alarming, data logging, information messages, global connections, and macros.

As you navigate through displays in Application Test mode, the Diagnostic List logs warnings and errors as they occur. Correct all logged errors and then retest the application to validate error correction.

**IMPORTANT** You must be connected to the controller and online before testing the application for accuracy.

Follow these steps to test run an application.

- 1. Open your converted application in FactoryTalk View ME software.
- 2. Test the application in one of two ways.
  - Choose Test Application from the Application menu.

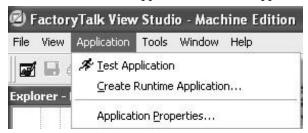

• Click the Test Application icon on the toolbar.



The emulator opens on your computer and runs the application. There is a two-hour limit for using the runtime emulator.

- TIP Local messages and graphic objects that are configured for multiple languages display in the current language of the application while in Test Application mode.
- 3. To exit the emulator, press x on your keyboard.
  - **TIP** The emulator window requires focus when pressing the x key to exit the emulator.

Notes:

Notes:

# **Create the Runtime Application**

## Introduction

In this chapter, you create, download, and run the converted application with all modifications on the PanelView™ Plus 7 terminal.

## **Before You Begin**


- Review migration considerations (Chapter 1).
- Select a PanelView Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Optionally install the PanelView Plus 7 terminal in the existing PanelView Standard panel cutout (Chapter 2).
- Import your PanelBuilder32 .pba application into FactoryTalk\* View ME software (Chapter 3).
- Review the conversion log for your migrated application (Chapter 4).
- Review object mapping (Chapter 5).
- Review unsupported features (Chapter 6).
- Qualify the runtime application (Chapter 7).

### **What You Need**

- Converted FactoryTalk View ME application.
- Qualified runtime application.

# **Follow These Steps**

Follow these steps to create a runtime application, download, and run the application on the PanelView Plus 7 terminal.



# Create the Runtime Application


Follow these steps to create a runtime application file from your converted Machine Edition .mer file.

- 1. Open your converted application in FactoryTalk View ME software.
- 2. Choose Create Runtime Application from the Application menu.




- 3. Enter a name for your runtime application or accept the default name.
- 4. Click Save to create the runtime file.

The file is saved to the default runtime location.

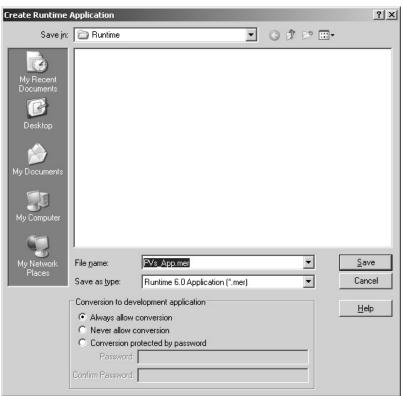

A dialog box shows the status of the runtime file creation. When the process completes, the dialog box automatically closes.




# Download the Runtime Application

You can download your runtime .mer application to a PanelView Plus 7 terminal by using an Ethernet connection or external storage device that is supported by your terminal.

## **Download Application Using Ethernet Connection**

Follow these steps to download your runtime application to the PanelView Plus 7 terminal by using an Ethernet connection.


- 1. Establish an Ethernet connection between your computer and the terminal.
- 2. Launch the transfer utility in one of two ways.
  - a. Choose Transfer Utility from the Tools menu.

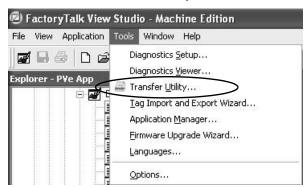


b. Click the appropriate tool on the toolbar.



3. To browse for the runtime file that you just created, click the ... button.

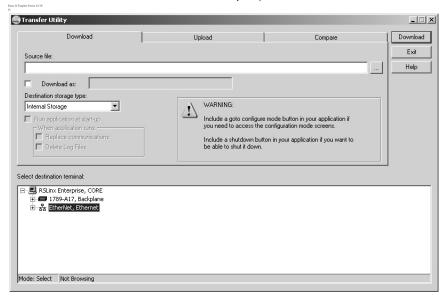


4. Select the runtime file that you just created and click Open.

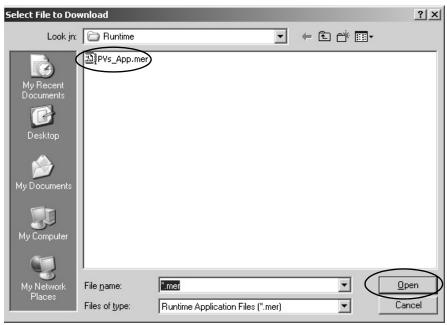

- 5. Under Select destination terminal, expand the Ethernet driver.
- 6. Browse for and select your PanelView Plus 7 terminal.


7. Click Download to download the runtime file to the PanelView Plus 7 terminal.

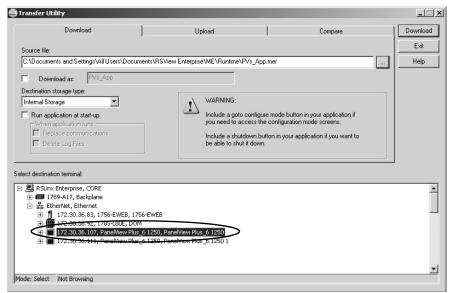


A progress bar shows the status of the download.




8. Click OK when the download has completed successfully.



9. On the PanelView Plus 7 terminal, load the application by pressing the Load Application button or pressing the [F1] function key.

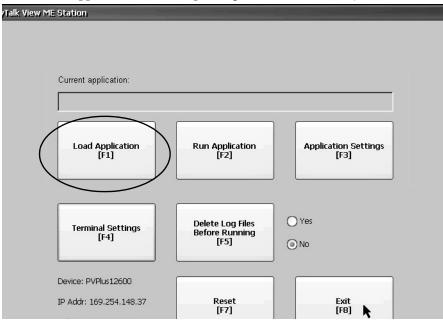


- 10. Select your runtime application.
  - a. Press the up or down cursor to select the application if multiple applications exist.
  - b. Press the Load button or the [F2] function key on terminal.

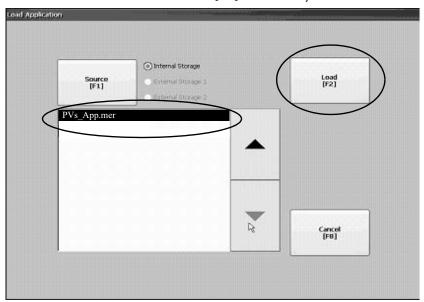

11. Press Yes or the [F7] function key on terminal to replace the communication settings in the terminal with the settings in your runtime application.

You are now ready to run the application on the terminal. Skip to page 91.

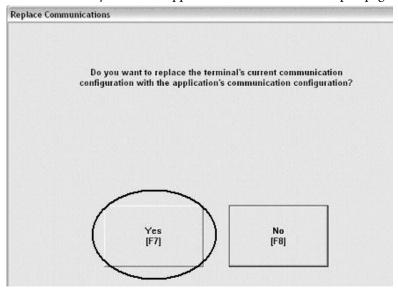

## **Download Application Using External Storage**

Follow these steps to load the runtime application on the PanelView Plus 7 terminal by using an external storage card.

Table 15 - External Storage Media


This Terminal Platform	Supports This External Storage	
PanelView Plus 7	Secure Digital (SD) card, cat. no. 1784-SDx	
	USB flash drive on USB host ports	

1. On your computer, copy the runtime application file to the runtime folder on a storage card that is supported by the terminal.





2. Turn off power to the terminal.

3. Load the storage card into the card slot of the terminal.

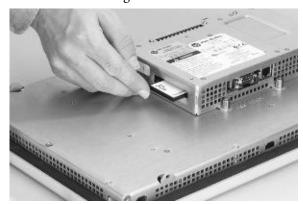


CompactFlash Card Slot on PanelView Plus 700 and 1500 terminals that support FactoryTalk View Machine Edition software version 5.1 or earlier.




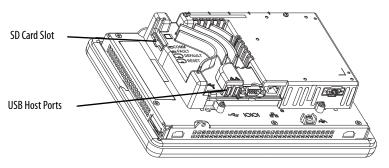


- 4. Turn on power to the PanelView Plus 7 terminal.
- 5. On the configuration display, press Load Application or the [F1] function key on the terminal.

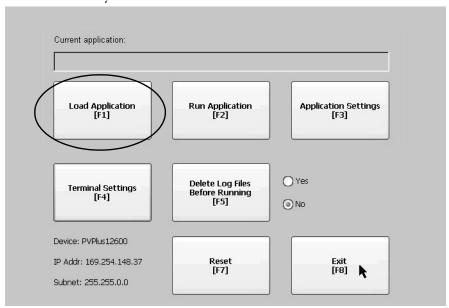

- 6. To select External Storrage 1 or 2, press the Source button or [F1] on the terminal.
- 7. Select your runtime application.
  - c. To select the application (if multiple applications exist), press the up or down cursor.
  - d. Press the Load button or [F2] function key on the terminal.

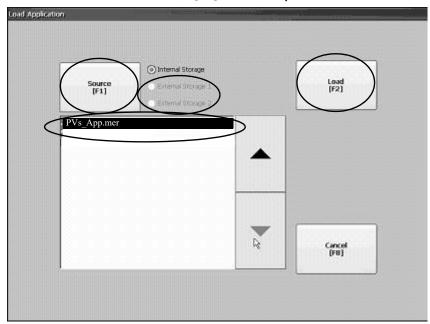


8. To replace the communication settings in the terminal with the settings in your runtime application, press Yes or the [F7] function key on the terminal.

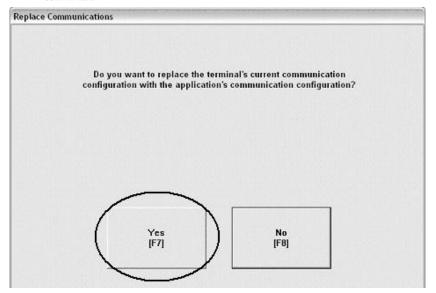

## **Run the Application**

Follow these steps to run your application on a PanelView Plus 7 terminal.

1. To run the currently loaded application, press Run Application or the [F2] function key on the terminal.

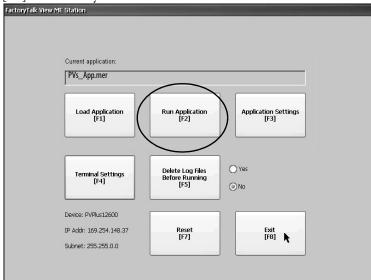

#### **IMPORTANT**

If your application is not communicating to the controller:

- Check all cable connections.
- Verify that the Target tab in the RSLinx® Enterprise Communication Setup is configured correctly.
- 2. Cycle through all runtime displays continuously.

Notes:

# **Optimize Runtime Performance**

## Introduction

In this chapter, you learn how to benchmark performance of your runtime application so that you can optimize as needed.

## **Before You Begin**


- Review migration considerations (Chapter 1).
- Select a PanelView<sup>™</sup> Plus 7 terminal replacement and adapter kit, if necessary (Chapter 2).
- Optionally install the PanelView Plus 7 terminal in the existing PanelView Standard panel cutout (Chapter 2).
- Import your PanelBuilder32 .pba application into FactoryTalk\* View ME software (Chapter 3).
- Review the conversion log for your migrated application (Chapter 4).
- Review object mapping (Chapter 5).
- Review unsupported features and common migration issues (Chapter 6).
- Correct, validate, and test the application (Chapter 7).
- Create, download, and run the application on a PanelView Plus 7 terminal (Chapter 8).

### **What You Need**

• A converted FactoryTalk View ME runtime application file that is downloaded and loaded in your PanelView Plus terminal.

## **Follow These Steps**

Follow this path to benchmark and optimize the performance of your converted application.

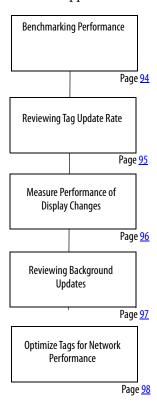

## **Benchmarking Performance**

You are now ready to compare performance of your PanelBuilder\*32 application running on a PanelView Standard terminal and the converted FactoryTalk View ME application running on a PanelView Plus 7 terminal.

You perform the benchmarking by functional areas so that you can optimize performance one step at a time. Each function may also provide alternative methods to improve performance where needed.


**IMPORTANT** 

Performance benchmarking between the terminal platforms is critical so that operators experience the same, if not better, performance on the new platform.

## **Reviewing Tag Update Rate**

The tag update response is dependent on where the tag is used in the application. Each display or feature has a maximum tag update rate. This parameter specifies the maximum rate at which new data is updated on the display, including tags used in expressions and embedded variables.

The default tag update rate is 1.0 second.

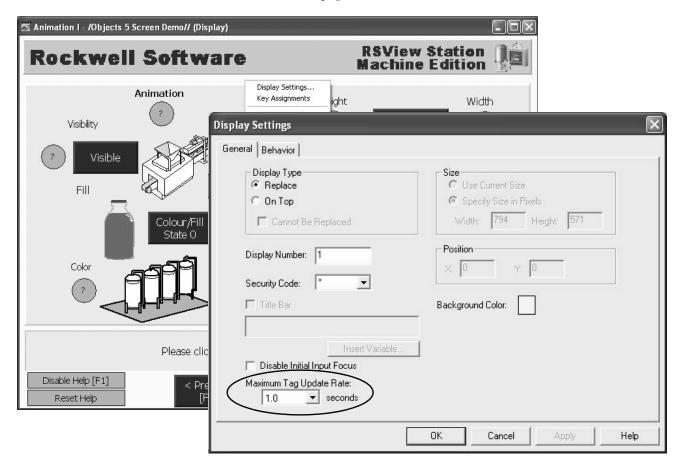

# Measure Performance of Display Changes

During performance benchmarking, you may want to measure the time it takes for the application to change from one display to another. It is important that the operator experiences the same display feedback, if not better, on the PanelView Plus 7 terminal.

If possible, place your PanelView Standard terminal and the new PanelView Plus 7 terminal side by side. Run the original PanelView Standard application and the converted PanelView Plus 7 application simultaneously.

Follow these steps to measure the length of time it takes to change from one display to another in the application.

- 1. Load and run your converted application on the PanelView Plus 7 terminal.
- 2. To record the time it takes to change from one display to another display, use a stopwatch in the next steps.
- 3. On any display, press the button that results in a display change and start recording the time.
- 4. Stop recording the time after all tag information is loaded on the next display.
- 5. Repeat steps <u>3</u> and <u>4</u> until you have recorded the times for all displays in the application.

## IMPORTANT

Cycle through all displays at least twice. The first time that you open a display it loads slower than subsequent displays because tag information is cached into memory after a display is opened.

6. If possible, repeat this procedure for the same application on the PanelView Standard terminal.

In a FactoryTalk View ME application, each display can have a maximum of 1000 tag connections assigned. The more tag connections a display has, the longer it takes to load the display.

If performance is slower for some displays in the PanelView Plus 7 application, you can do one of the following:

- Adjust the maximum tag update rate for these displays
- Reduce the number of tags that are used on these displays

# Reviewing Background Updates

Background tags are continuously updated by the runtime application whether or not the operator is on a specific display. Tags update according to the maximum tag update rate for the associated feature.

The more familiar you are with these tags and features, the easier it is to update and fine tune your application.


**TIP** Set noncritical tags to a longer maximum update rate. Set critical tags to a lower rate so that time-sensitive information is always available to the operator.

#### **Global Connections**

The Global Connections editor provides a list of connections that you can assign to tags:


- Date and Time
- Display
- Macro
- Backlight
- Memory

These tags are continuously updated in the background by the application, regardless of what display is active. The tags update according to the setting of the maximum update rate parameter.

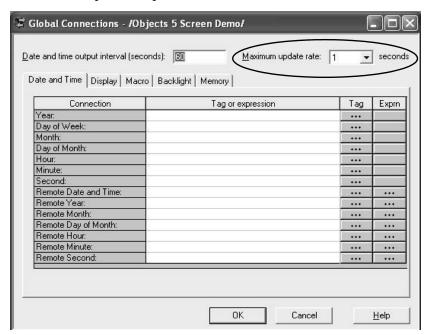


#### **Alarms**

The Alarm Setup editor lets you define triggers, messages, and advanced features for alarms. Any trigger tags or optional connections that are assigned within the editor update according to the maximum update rate. This parameter is on the Advanced tab.

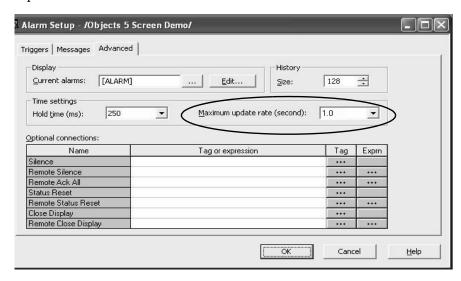

### **Information Messages**

The Information Message editor lets you specify information messages to automatically display on a user-defined display. The tags that are assigned in this editor, update at the rate defined by the maximum update rate.

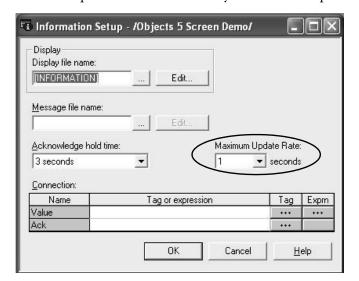

# Optimize Tags for Network Performance

You can further improve network performance by converting the application tags from HMI tags to direct reference tags.

The tag converter wizard (TCW) automatically converts tags in an application from HMI tags to direct reference tags.

**TIP** You can download The TCW utility from the Knowledgebase. See Technote 31289.

### **About the Tag Converter Wizard**

The tag converter wizard (TCW) requires information from an existing application to perform the conversion:

- Exported HMI tag database
- Exported displays (xml format)
- Exported alarms (xml format)

When this pre-conversion information is available, you can run the wizard. The wizard examines the HMI tag database to determine which tags to convert to alias tags or direct reference tags.

#### **IMPORTANT**

The tag converter wizard converts HMI tags to device tags. It does not convert device tags to HMI tags. Back up your application before starting the conversion. The conversion alters the original displays when imported into your new application.

### Remote I/O Applications

#### **IMPORTANT**

For Remote I/O applications, HMI tags that use custom scale and offsets are not converted. Any alias tags with initial values assigned are not converted. You must manually set the custom scale, offsets, and initial values for these tags, for objects to operate correctly.

The HMI tags are substituted with the alias or device tags in the display and alarm xml files. When the conversion is done, a Convert\_Log.txt file is generated. This file indicates all tag substitutions on a display-by-display basis. A new set of display and alarm xml files are created that you can import into your migrated application. The original display and alarm xml files are unaltered.

#### Non-Remote I/O Applications

For all non-Remote I/O applications, HMI tags are converted to direct reference tags regardless of scale, offset, and min/max values. This conversion includes Ethernet, DF1, DH+ $^{\text{\tiny TM}}$ , and DH-485 applications.

#### **IMPORTANT**


Memory tags are not converted. You must convert memory tags manually before running the Tag Converter Wizard.

The TCW does not add the L parameter to alarm trigger tags. See <u>page 12</u> for details on converting alarm trigger tags to direct reference.

### **Export the HMI Tag Database**


Follow these pre-conversion steps to export the HMI tag database in your migrated application.


1. Launch FactoryTalk View Studio software.

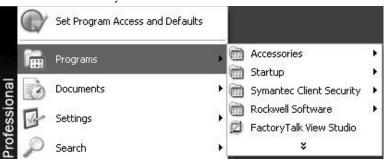

2. Select your ME application and click Open.




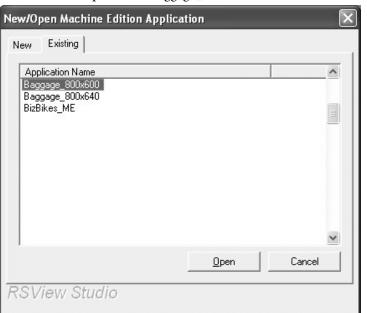

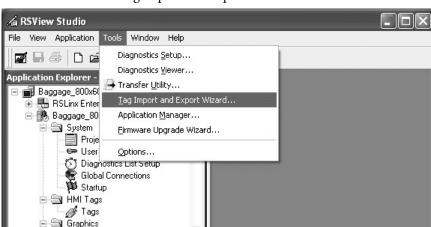

3. Choose Tools>Tag Import and Export Wizard from the Tools menu.

4. In the Operation field, select Export RSView Tag Database to CSV files and click Next.

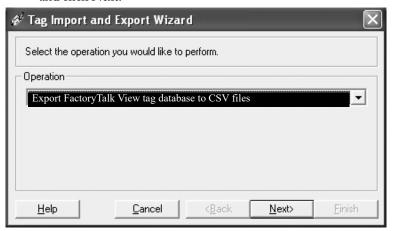

5. Click the ... button and browse to the project .med file and click Next.


This example uses Baggage\_800x600.med.



6. Accept the default name for the destination file.

#### 7. Click Finish.

You have successfully exported the HMI tag database.

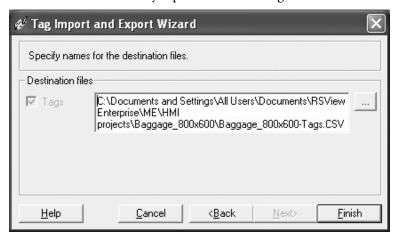


The default destination of the .csv file is:

C:\Documents and Settings\All Users\Documents\RSView
Enterprise\ME\HMI Projects\Project\_Name\Project\_Name-Tags.CSV

## **Export Graphic Displays to XML File**

Follow these pre-conversion steps to export the graphics display in your converted application to an xml format.


- 1. Navigate back to the open instance of the FactoryTalk View Studio software.
- 2. In the Application Explorer, right-click Displays and choose Import and Export.

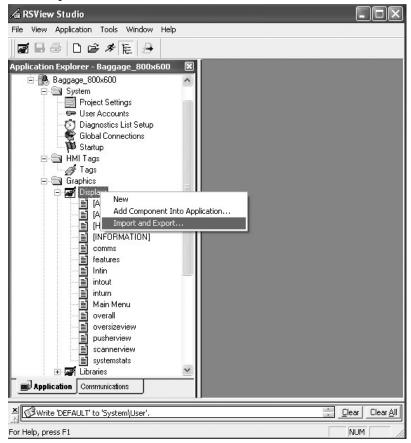

3. Select Export graphic information from displays and click Next.




4. Click Select All, then Next.

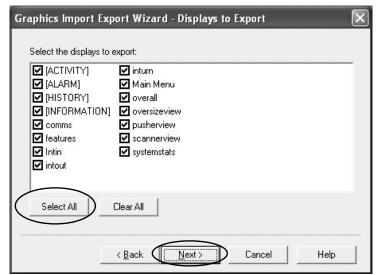


- 5. Click the ... button.
- 6. Create a folder anywhere on your computer named Exported Displays.

#### 7. Click Finish.

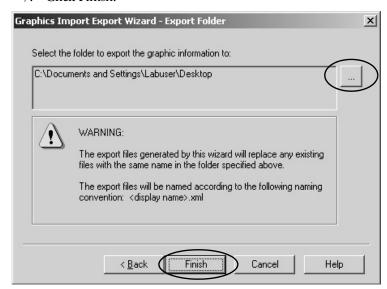


A dialog box shows the name of each graphic display as it is exported to an .xml file.

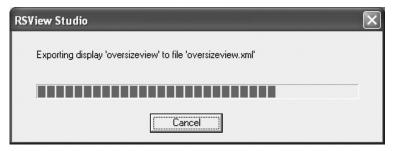

8. Review the Display\_Export.txt file for any errors that are generated during the export.


The displays have been successfully exported to the folder created in step  $\underline{6}$ .

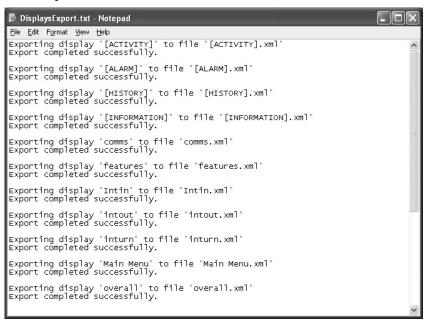


### **Export Alarms to XML File**

Follow these pre-conversion steps to export alarms in your converted application to an xml format.

- 1. Navigate back to the open instance of the FactoryTalk View Studio software.
- 2. In the Application Explorer, right-click Alarm Setup and choose Import and Export.

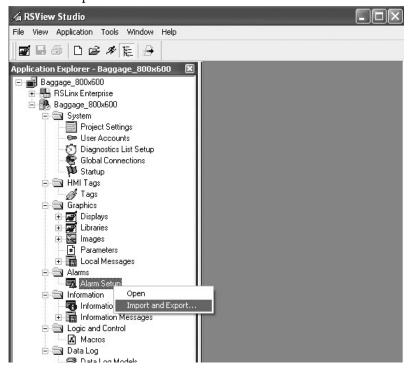


3. Select Export alarm configuration from application and click Next.

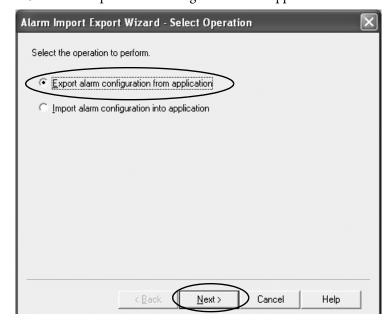

4. Accept the default file name Alarms and click Finish.

The alarms have been successfully exported to the alarms.xml file.

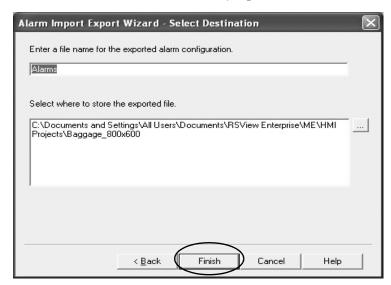

The default location for the alarm.xml file is:

C:\Documents and Settings\All Users\Documents\RSView Enterprise\ME\HMI Projects\Project\_Name\Alarms.xml


### **Run the Tag Converter Wizard**

Now that you have completed the pre-conversion process, you are ready to run the tag converter wizard. The executable file is named TCW.exe.

#### **TIP** The original HMI tag database is not altered.

During the conversion, most of the tags are converted to direct reference tags. You will have to manually set scale and offset values for tags after the conversion.

1. Double-click the TCW.exe utility.

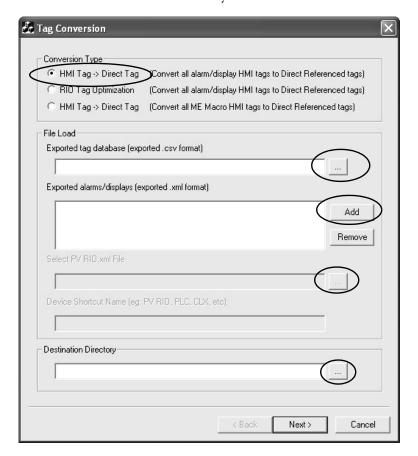

- 2. Select the HMI Tag -> Direct Tag conversion type.
- 3. Click the ... button next to the Exported Tag Database field and load the exported tag database.


The file is located in the directory that is specified in step  $\underline{6}$  on page  $\underline{101}$ .

- 4. Click the Add button next to Exported alarms/displays.
- 5. Load the exported alarms and display xml files.

The alarms file is located in the folder that is specified under step  $\underline{4}$  on page  $\underline{108}$ .


The xml display files are located in the folder that is specified in step  $\underline{6}$  on page  $\underline{104}$ .


Hold down the Shift key and select all displays to load all displays at once.

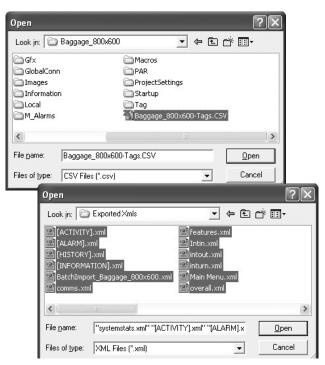

6. In the Destination Directory field, click the ... button to specify any location for the new xml display files.


The example that is shown may look different depending on the network protocol of your application.



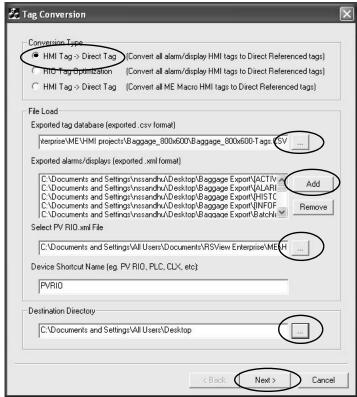

The Report dialog box shows the number of tag and display substitutions made.

8. Click Finish.

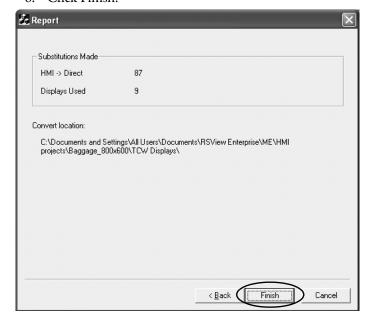

A conversion log file, Conversion\_Log.txt, is created and stored with the converted xml files.

The conversion process is complete. The utility has successfully converted all HMI device tags to alias or direct reference tags in all displays.



In addition to the conversion log file, the tag converter wizard generates a tag cross-reference .csv file in the destination folder. This file cross-references HMI tags to alias and direct reference tags.

When you open the .csv file in Excel, three columns show how the tags are linked.

HMI Tag	Alias Tag	Direct Reference Tag	
Tag1	MotorSart1	N7:0	


### **Reimport the Display XML File**

Now that you have converted all alarms and displays, you are ready to reimport the information into your application.


IMPORTANT	Manually copy the BatchImport_Your_Project_Name.xml file to the	
	location of the new displays that are created by the TCW utility. Select the	
	xml file from this folder so all new displays are imported, not the original,	
	unmodified displays.	

Follow these steps to reimport the xml display files to your application.

- 1. Navigate back to the open instance of the FactoryTalk View Studio software.
- In the Application Explorer, right-click Displays and choose Import and Export.

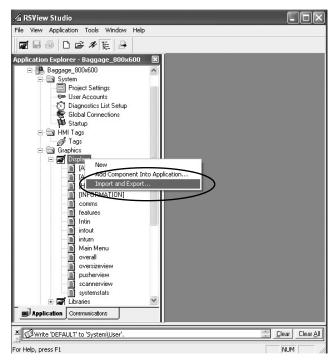


3. Select Import graphic information into displays and click Next.




4. Select No to not back up the displays.

You completed this action when you exported graphic displays to xml format on page 103.

5. Click Next.

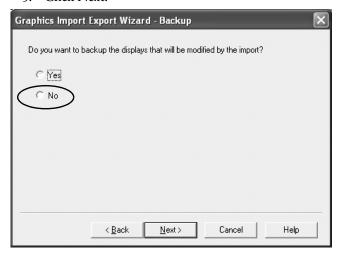


6. Select Multiple displays batch import file and click Next.

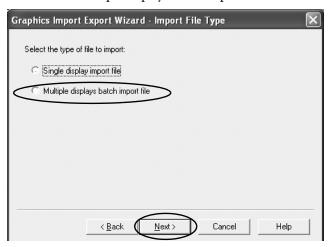


7. Click the ... button.



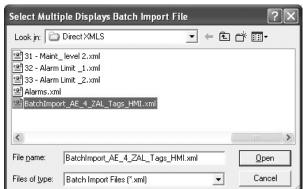

8. Select and open the BatchImport\_Your\_Project\_Name.xml

- 9. Select Update existing objects on the display.
- 10. Click Finish.

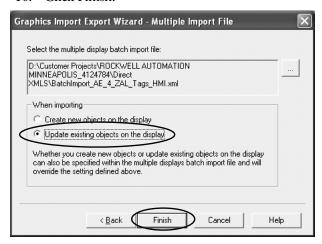

11. Review the DisplaysImport.txt file for errors.

The new alias and direct reference tags have been successfully imported into the application.


```
Displaysimport.ixt - Notepad

Ele Edt Fgmat View Help
Importing file '[ACTIVITY].xml' into display '[ACTIVITY]'
Import completed successfully.
Importing file '[ALARM].xml' into display '[ALARM]'
Import completed successfully.
Importing file '[INFORMATION].xml' into display '[HISTORY]'
Import completed successfully.
Importing file '[INFORMATION].xml' into display '[INFORMATION]'
Import completed successfully.
Importing file 'comms.xml' into display 'comms'
Import completed successfully.
Importing file 'features.xml' into display 'features'
Import completed successfully.
Importing file 'Intin.xml' into display 'Intin'
Import completed successfully.
Importing file 'intout.xml' into display 'intout'
Import completed successfully.
Importing file 'inturn.xml' into display 'inturn'
Import completed successfully.
Importing file 'Main Menu.xml' into display 'Main Menu'
Import completed successfully.
Importing file 'Wain Menu.xml' into display 'werall'
Import completed successfully.
```

### **Reimport the Alarms XML File**

Follow these steps to reimport the xml alarms file to your application.

- 1. Navigate back to the open instance of the FactoryTalk View Studio software.
- 2. In the Application Explorer, right-click Alarm Setup and choose Import and Export.

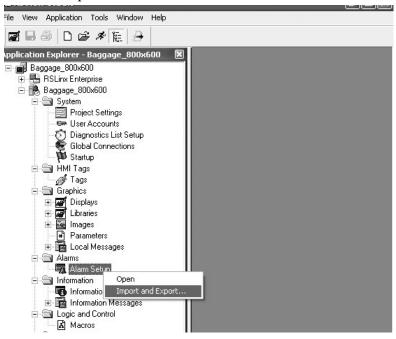

- 3. Select No to not back up the alarms.
- 4. Click Next.



5. To select the Alarms.xml file from created by the TCW utility, click the ... button.

#### 6. Click Finish.

The project has been successfully updated with the new alarms.



You can now retest your application for optimized performance.

Notes:

# **Advanced Object Editing**

### Introduction

Editing techniques can save you time when using FactoryTalk\* View Studio software. Use these techniques to reduce the migration effort when updating common properties between multiple graphic objects:


- Property panel
- Editing multiple objects
- Object explorer
- Tag substitution

## **Property Panel**

The property panel is a powerful editing tool that you can use to perform quick edits and tag assignments by simply clicking a graphic object. You can modify the property values of graphic objects, and assign tags and expressions to objects. Any edits that you make in the property panel are applied immediately.


Follow these steps to open the property panel.

With a graphic display open, choose View>Property Panel.
 The property panel may not contain any information in it. This status is the result of not selecting an object.

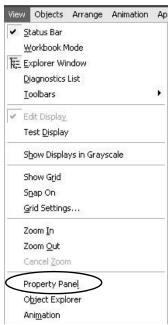


2. Select a graphic object on the display.

This example shows a text object selected. The property panel shows all properties that you can edit for the selected object.

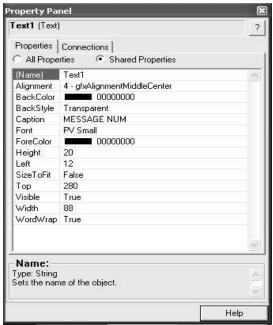

3. To view and edit the tag connection properties for the selected object, select the Connections tab.

This example shows the Value and Polarity connections for a numeric display object.



# **Edit Multiple Objects**

One of the most useful features of the property panel is that you can edit multiple graphic objects with common properties simultaneously, rather than editing each object, one by one.


Chapter 6, Review Unsupported Features, showed you how to create replacement multistate indicator, local message and numeric data display list objects in FactoryTalk View ME software. Creating this replacement graphic objects also required you to update properties to match the original PanelBuilder\*32 objects. These properties included captions, foreground/background colors, text size, number of states, and more.


Follow these steps to change a few properties for a group of ten multistate indicator objects.

1. Select a group of graphic objects you want to edit.

If your objects are not grouped, simply hold down the Ctrl key and click each object.

When a set of grouped objects are selected, the property panel shows only the grouped properties.







Click the Include Grouped Objects button on the property panel.
 You see all properties that can be edited for the objects in the group.
 Clicking any property provides a popup, pull-down menu, or other editing method.

In the next step, you will change the ST\_Caption from \*\*\*\* to State 0 and the ST\_BackColor to Green. These changes are then applied to all selected objects for the state that is defined in the State property.

To change other states, simply change the State property to State1 and make the desired edits.

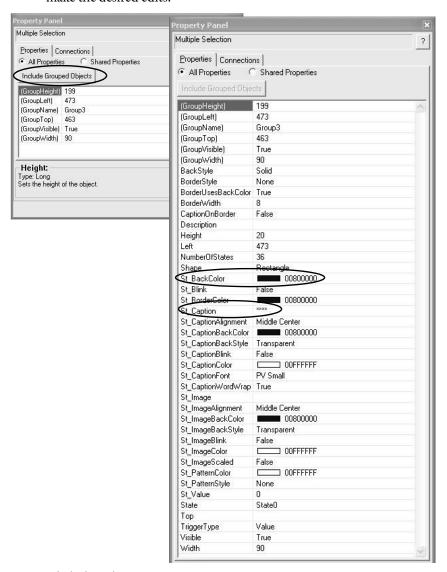

3. Click the ... button next to St\_Caption.




4. Type the new caption in the String Edit dialog box and click OK.

- Click the ... button in the St BackColor field.
- 6. In the color palette that opens, click a new color.

The example shows the grouped objects before and after edits.

Depending on the object you are editing, the properties differ. Help text at the bottom identifies what the property does.



TIP You can apply this editing technique to cursor llst objects, depending on the number of objects. This action saves you time when updating your objects in FactoryTalk View ME software to match the original PanelBuilder32 object.

### **Object Explorer**

The object explorer provides a tree-list of all objects in the selected display. You can select and highlight objects in this list.

Groups are listed as expandable items, with the + icon. To view the objects in a group, click the + icon or double-click the group name. The list expands to show the objects and groups within a group.

You can use the highlight settings to highlight specified objects on both the graphic display and object explorer. You can select objects by object type, by animation type, or by tag name.

For a display with many objects, object explorer provides an efficient way of locating and selecting graphic objects. If you want to edit specific objects, object explorer can highlight these objects for you. By using the property panel, you can do one the following:

• Perform multiple edits instantly


• Double-click the object in object explorer to open the properties dialog box and make edits to a single object

Follow these steps to open object explorer.

- 1. With a graphic display open, choose View>Object Explorer.
- 2. Expand or collapse groups of objects by clicking the Expand or Collapse buttons.


The objects that appear in the list differ for each display.

3. To search for objects, click the Settings button.




The Highlight Settings dialog box allows you to search for objects by Object Type, Animation Type, or Tag Name.

When selecting by tag name, the list shows all tags and expressions that are referenced by objects in the display, except tags with embedded variables.




4. Select Local Message Objects to search for all local message objects.



5. Click OK to return to the object explorer.

6. Check the Highlighting on checkbox and click the Expand button.





The object explorer highlights all local message displays in red.

Local message objects on the display also appear red with a border.


If you have a display with a red background, the red highlights are not visible.

When you select an object in the object explorer, the Highlight mode turns off. Simply, recheck the Highlight on box to turn the highlights back on.

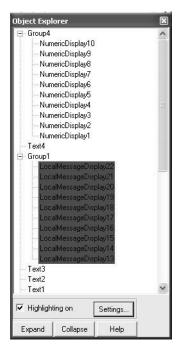




- 7. To open the properties for the local message display, double-click an object in the object explorer.
- 8. Edit the properties and click OK.

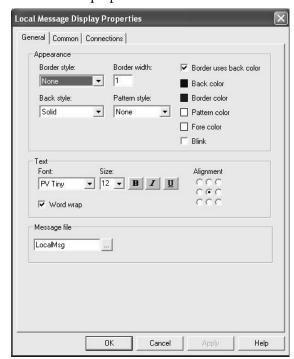

If the property panel and object explorer are both open, click any object in object explorer. The property panel updates the display with the edit properties for the selected objects. You can make any updates from the property panel.

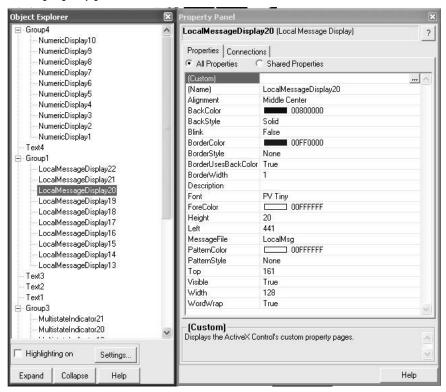

### **Substitute Tags**


You can use tag substitution to replace tag names or character strings in all selected graphic objects on a display. Character strings include tag placeholders, expressions, and parts of strings within expressions. When replacing tags, you can use an entire tag name, including folders, or you can replace a string of characters.

**TIP** You cannot use wildcard characters when searching for or replacing tag names.

Tag substitution is useful when your graphic displays use a direct reference tag name or if an HMI Tag name is referenced throughout your application and must be updated.

Follow these steps to substitute a tag or character string.

- 1. Open the graphic display that you want to update.
- To select all objects in the display, press Ctrl-A.
   All objects on the display are highlighted. This example display is for illustration purposes only.

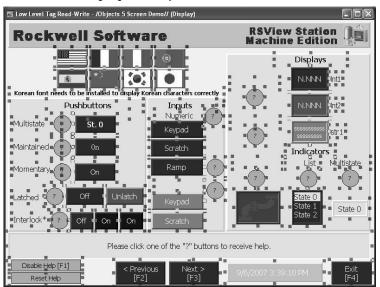

**TIP** You must select all objects or the Tag Substitution dialog box only shows tags of the selected objects.





In the Tag Substitution editor, you can search on an existing name or a part of a tag name.

- 4. Type mem in the Search for box.
- 5. Type tag in the Replace with box.

Uncheck the Confirm Replacement option, if you don't want to confirm every replacement.

6. Click Replace.

The editor searches for each tag that contains the partial string mem and replaces the string with tag. You are prompted to confirm each replacement.




7. Click Replace All to confirm the replacement of all tags at once.




You are notified when the substitution is complete.

8. Click OK.



9. To verify that tags with the string mem were updated to tag, choose Edit>Tag Substitution.

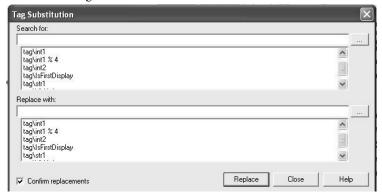

You can use tag substitution on a display-by-display basis to verify that all tags or partial strings are updated correctly in the application.

Α	I
adapter plates 18	import
alarms 98	alarm xml file 116
	display xml file 112
n	importing application 48
В	communication mapping 63
background updates 97	conversion log 54 data type mapping 62
	object mapping 62
C	, 11 3
•	M
communication	
configuring 71  CompactFlash card downloads 84	mapping
conversion	communication protocols 63 data types 62
tips 52	objects 62
conversion log 54	migrated application
alarm conversion messages 59	ControlNet communication 76
messages 56	create runtime application 83
opening 54 reviewing 54	DH+ communication 74 diagnostic list 70
RSLinx messages 56	download runtime application 84
screen and object messages 57	run application 91
tag conversion messages 59	test run 76, 79
	test run displays 76 unsupported features 66
D	migration considerations 11
data type mapping 62	<b>3</b>
diagnostic list 70	•
download runtime application	U
Ethernet connection 84	object editing
external storage device 88	multiple objects 120
	object explorer 123 property panel 119
E	tag substitution 128
editing multiple objects 120	object explorer 123, 128
error states for objects 70, 71, 73	object mapping 62
export	
alarms to xml file 107	Р
graphic displays to xml file 103	<u>-</u>
hmi tag database 100	performance
	background updates 97 converting tags 99
F	measuring 96
FactoryTalk View ME software	optimize tags 98
conversion log 54	post conversion tips 52
diagnostic list 70	property panel 119
editing multiple objects 120	
editing objects 119 error states 73	
import application 48	
object explorer 123	_
property panel 119	R
tag substitution 128	run application 84, 91
test run displays 76 unsupported features 66	runtime application
and approved realists of	create 83
c	download 84
G	runtime diagnostic display
global memory connections 79	configure 71

T

tag converter wizard 99 run 109 tag substitution 128 terminal replacements 18 test run application 79 displays 76

U

**unsupported features** 66 objects 66

### **Rockwell Automation Support**

Use the following resources to access support information.

Technical Support Center	Knowledgebase Articles, How-to Videos, FAQs, Chat, User Forums, and Product Notification Updates.	https://rockwellautomation.custhelp.com/	
Local Technical Support Phone Numbers	Locate the phone number for your country.	http://www.rockwellautomation.com/global/support/get-support-now.page	
Direct Dial Codes	Find the Direct Dial Code for your product. Use the code to route your call directly to a technical support engineer.	http://www.rockwellautomation.com/global/support/direct-dial.page	
Literature Library	Installation Instructions, Manuals, Brochures, and Technical Data.	http://www.rockwellautomation.com/global/literature-library/overview.page	
Product Compatibility and Download Center (PCDC)	Get help determining how products interact, check features and capabilities, and find associated firmware.	http://www.rockwellautomation.com/global/support/pcdc.page	

#### **Documentation Feedback**

Your comments will help us serve your documentation needs better. If you have any suggestions on how to improve this document, complete the How Are We Doing? form at <a href="http://literature.rockwellautomation.com/idc/groups/literature/documents/du/ra-du002\_-en-e.pdf">http://literature.rockwellautomation.com/idc/groups/literature/documents/du/ra-du002\_-en-e.pdf</a>.

Rockwell Automation maintains current product environmental information on its website at <a href="http://www.rockwellautomation.com/rockwellautomation/about-us/sustainability-ethics/product-environmental-compliance.page">http://www.rockwellautomation.com/rockwellautomation/about-us/sustainability-ethics/product-environmental-compliance.page</a>.

Allen-Bradley, AutoMax, ControlLogix, DH+, Encompass, FactoryTalk, Logix5000, PanelBuilder, PanelView, PLC-5, Rockwell Automation, RSLinx, RSLinx Enterprise, RSView, and SLC are trademarks of Rockwell Automation, Inc.

Trademarks not belonging to Rockwell Automation are property of their respective companies.

Rockwell Otomasyon Ticaret A.Ş., Kar Plaza İş Merkezi E Blok Kat:6 34752 İçerenköy, İstanbul, Tel: +90 (216) 5698400

#### www.rockwellautomation.com

#### Power, Control and Information Solutions Headquarters

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444 Europe/Middle East/Africa: Rockwell Automation NV, Pegasus Park, De Kleetlaan 12a, 1831 Diegem, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640 Asia Pacific: Rockwell Automation, Level 14, Core F, Cyberport 3, 100 Cyberport Road, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846